



**LOGIX<sup>®</sup>**  
BRANDS  
ENGINEERED INSULATION PRODUCTS


# PATHWAY TO PERFORMANCE

(CANADA)


**A Building Science-Principled Plan  
To Help Builders Profitably Construct Healthy  
& Durable Code-Compliant Homes.**

**Additional Best Practices Guidelines Are  
Provided To Help Builders Reliably  
Achieve Progressively Higher Levels Of  
Building Envelope Performance.**


**ELEMENTICF<sup>®</sup>**  
LOGIX BRANDS




**HALO<sup>®</sup>**  
ADVANCED GRAPHITE INSULATION SYSTEM



**HEAT-SHEET<sup>®</sup>**



**CHROMEGPS<sup>®</sup>**  
PROFESSIONAL GRADE GRAPHITE INSULATION

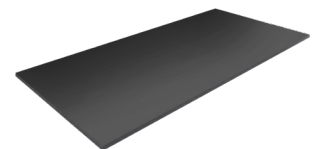

## **Disclaimer of Liability**

Reference to “Logix Brands Ltd.” means the manufacturer (the “Manufacturer”) selling the product(s) referenced in the Title section (the “Products”) of the enclosed drawings (the “Drawings”) to consumers (the “User”). The Manufacturer sells its Products “as is” and the consents of the Drawings are provided “as is”.

**NO EXPRESS WARRANTIES ARE GIVEN. ALL WARRANTIES, EXPRESS, STATUTORY AND IMPLIED, INCLUDING BUT NOT LIMITED TO, WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE, ARE EXPRESSLY DISCLAIMED.**

The User assumes all risks as to the use of the Products and/or the Drawings. The Drawings are to be used as reference guides only. The User shall confirm the information contained in the Drawings meets local building codes and construction practices by consulting with local building officials and professionals, and determine if there are any additional building and/or construction requirements. Before use, the User should fully investigate the Products to enable informed choices as to suitability for a particular construction project and proper design and implementation. It is the User’s responsibility and obligation to ensure all work performed conforms to applicable building code and labour safety regulations governing the construction.

As the Manufacturer has no control over installation design and workmanship, accessory materials or application conditions, the Manufacturer does not warranty the performance or results of any installation containing the Products and/or derived from the Drawings. The User acknowledges that it has not relied upon any representation, condition or warranty made by the Manufacturer or any other person on the Manufacturer’s behalf.

The Manufacturer assumes no responsibility that its Products will be fit for any particular purpose, the Manufacturer will not be liable for any direct, incidental, consequently or indirect damages (including lost profits) arising out of the use of its Products and/or the Drawings.

The Manufacturer reserves the right to make changes to the Drawings without notice and assumes no liability in connection with the use of the Drawings.

© Copyright Logix Brands Ltd. 2023 All rights reserved.

No part of the work contained herein as covered by this copyright may be reproduced or used in any form, or any means – graphic, electronic or mechanical, including without limitation photocopying.

# Table of Contents

---

## Typical Section Drawings

Halo® Exterra® Above Grade Wall Assembly & ICF Below Grade Assembly.....	1
Chrome GPS® Above Grade Wall Assembly & ICF Below Grade Assembly .....	2
ICF Above Grade Wall Assembly & ICF Below Grade Assembly.....	3
Halo® Exterra® Above Grade Wall Assembly & Halo® Subterra® or Subterra® Plus Below Grade Assembly .....	4
Chrome GPS® Above Grade Wall Assembly & Halo® Subterra® or Subterra® Plus Below Grade Assembly .....	5
Halo® Exterra® Above Grade Wall Assembly & Halo® Interra® & Halo® Subterra® or Subterra® Plus Below Grade Assembly .....	6
Chrome GPS® Above Grade Wall Assembly & Halo® Interra® & Halo® Subterra® or Subterra® Plus Below Grade Assembly .....	7
Halo® Exterra® Above Grade Wall Assembly Halo® Subterra® or Subterra® Plus Slab-On-Grade Detail.....	8
Chrome GPS® Above Grade Wall Assembly & Halo® Subterra® or Subterra® Plus Slab-On-Grade Detail.....	9
ICF Above Grade Wall Assembly & Halo® Subterra® or Subterra® Plus Slab-On-Grade Detail.....	10

## Window Details

Halo® Exterra® Window Detail .....	11
Chrome GPS® Window Detail .....	12
ICF Window Detail .....	13

## Flat Roof Drawings

Halo® Exterra® Above Grade Wall Assembly & Self-Adhered Flat Roof Assembly.....	14
Chrome GPS® Above Grade Wall Assembly & Self-Adhered Flat Roof Assembly.....	15
ICF Wall Assembly & Self-Adhered Flat Roof Assembly .....	16

## Radon Mitigation Drawings

Heat-Sheet® Heavy & Halo® Subterra® Plus Radon Mitigation System .....	17
Halo® Subterra® Plus Radon Mitigation System .....	18
Heat-Sheet® Heavy Radon Mitigation System (ICF Foundation) Option 1 .....	19
Heat-Sheet® Heavy Radon Mitigation System (ICF Foundation) Option 2 .....	20
Heat-Sheet® Heavy Radon Mitigation System (Interior Foundation Insulation) Option 1 .....	21
Heat-Sheet® Heavy Radon Mitigation System (Interior Foundation Insulation) Option 2 .....	22
Heat-Sheet® Heavy Radon Mitigation System (Exterior Foundation Insulation) Option 1.....	23
Heat-Sheet® Heavy Radon Mitigation System (Exterior Foundation Insulation) Option 2.....	24

EAVE PROTECTION SHALL BE PROVIDED ON SHINGLE, SHAKE OR TILE ROOFS, EXTENDING FROM THE EDGE OF THE ROOF A MINIMUM OF 36" (900MM) UP TO THE ROOF SLOPE TO A LINE NOT LESS THAN 12" (300MM) INSIDE THE INNER FACE OF THE EXTERIOR WALL (NBC 9.26.5.1.)

**BEST PRACTICE:** DRIP EDGE AT EAVE OF ROOF

**ROOF VENTING REQUIREMENTS**

- UNOBSTRUCTED VENT AREA SHALL NOT BE LESS THAN  $\frac{1}{100}$  OF THE INSULATED CEILING AREA OR WHERE ROOF SLOPE IS LESS THAN 1 IN 6 OR IN ROOFS THAT ARE CONSTRUCTED WITH ROOF JOISTS, THE UNOBSTRUCTED VENT AREA SHALL BE NOT LESS THAN  $\frac{1}{50}$  OF THE INSULATED CEILING AREA (NBC 9.19.1.1.)
- REQUIRED VENTS MAY BE ROOF TYPE, EAVE TYPE, GABLE-END TYPE OF ANY COMBINATION THEREOF, & SHALL BE DISTRIBUTED: UNIFORMLY ON OPPOSITE SIDES OF THE BUILDING, WITH NOT LESS THAN 25% OF THE REQUIRED OPENINGS LOCATED AT THE TOP OF THE SPACE, & WITH NOT LESS THAN 25% OF THE REQUIRED OPENINGS LOCATED AT THE BOTTOM OF THE SPACE (NBC 9.19.1.2.)

WHERE WALLS REQUIRED TO PROVIDE PROTECTION FROM PRECIPITATION COMPRISE CLADDING ASSEMBLIES WITH FIRST & SECOND PLANES OF PROTECTION,

- THE FIRST PLANE OF PROTECTION (CLADDING) SHALL CONSIST OF CLADDING WITH APPROPRIATE TRIM, ACCESSORY PIECES & FASTENERS
- THE SECOND PLANE OF PROTECTION (HALO® EXTERRA® WITH TAPED OR CAULKED JOINTS & FASTENER PENETRATIONS, ALTERNATIVE DETAIL, MEMBRANE INSTALLED ON TOP OR BEHIND RIGID INSULATION) SHALL BE DESIGNED & CONSTRUCTED TO:
  - INTERCEPT ALL RAIN & SNOW THAT GETS PAST THE FIRST PLANE OF PROTECTION, & EFFECTIVELY DISSIPATE ANY RAIN OR SNOW TO THE EXTERIOR, & THE PROTECTION PROVIDED BY THE FIRST & SECOND PLANES PROTECTION SHALL BE MAINTAINED
  - AT WALL PENETRATIONS CREATED BY THE INSTALLATION OF COMPONENTS AND SERVICES SUCH AS WINDOWS, DOORS, VENTILATION DUCTS, PIPING, WIRING & ELECTRICAL OUTLETS (NBC 9.27.2.3.)

AT LEAST ONE LAYER OF SHEATHING MEMBRANE SHALL BE APPLIED BENEATH CLADDING (NBC 9.27.3.3.), WHERE NON-WOOD-BASED RIGID EXTERIOR INSULATING SHEATHING, OR EXTERIOR INSULATING SHEATHING WITH AN INTEGRAL SHEATHING MEMBRANE IS INSTALLED, A SEPARATE SHEATHING MEMBRANE IS NOT REQUIRED (NBC 9.27.3.4.)

CLADDING SHALL BE FASTENED TO THE FRAMING MEMBERS OR FURRING MEMBERS, OR TO BLOCKING BETWEEN FRAMING MEMBERS (NBC 9.27.5.1.)

REQUIREMENTS FOR LOW TO MODERATE WIND & SEISMIC FORCES, BRACING TO RESIST LATERAL LOADS SHALL BE DESIGNED & CONSTRUCTED AS FOLLOWS: i) CLAD WITH PANEL-TYPE CLADDING IN ACCORDANCE WITH NBC SECTION 9.27., ii) SHEATHING WITH PLYWOOD, OSB, WAFERBOARD, FIBREBOARD, GYPSUM BOARD OR DIAGONAL LUMBER SHEATHING, iii) FINISHED ON THE INTERIOR WITH A PANEL-TYPE MATERIAL IN ACCORDANCE WITH THE REQUIREMENTS OF NBC SECTION 9.29. OR IN ACCORDANCE WITH NBC ARTICLES 9.23.13.4. TO 9.23.13.7., PART 4, GOOD ENGINEERING PRACTICE SUCH AS THAT PROVIDED IN CWC 2014, "ENGINEERING GUIDE FOR WOOD FRAME CONSTRUCTION" (NBC 9.23.13.1.)

**BEST PRACTICE:** BUG SCREEN TOP & BOTTOM OF VENTILATED AIR SPACE

EXTERIOR FOUNDATION WALLS SHALL EXTEND NOT LESS THAN 6" (150MM) ABOVE FINISHED GROUND LEVEL (NBC 9.15.4.6.) INSULATION ABOVE GRADE CANNOT BE LEFT EXPOSED COVER WITH ACRYLIC PARGING (NBC 9.25.2.3. 6) 7), OPTIONAL: GYPSUM OR CONCRETE BOARD


WHERE THE EXTERIOR FINISHED GROUND LEVEL IS AT A HIGHER ELEVATION THAN THE GROUND LEVEL INSIDE THE FOUNDATION WALLS, EXTERIOR SURFACES OF FOUNDATION WALLS BELOW GROUND LEVEL SHALL BE DAMPPROOFED (NBC 9.13.2.1.) **BEST PRACTICE:** PEEL & STICK OR LIQUID APPLIED NON-PERMEABLE MEMBRANE APPLIED TO ICF BLOCK PRIOR TO DRAINAGE LAYER

DRAINAGE LAYER SHALL BE INSTALLED: MINERAL FIBRE INSULATION OR GRANULAR MATERIAL OR A SYSTEM THAT PROVIDES EQUIVALENT PERFORMANCE (NBC 9.14.2.1.)

**BEST PRACTICE:** COVER GRANULAR FILL WITH FABRIC CLOTH

MIN. 4" (100MM) DIAM. DRAIN TILE OR PIPE (NBC 9.14.3.2.) COVERED WITH NOT LESS THAN 6" (150MM) CRUSHED STONE OR OTHER COARSE CLEAN GRANULAR MATERIAL CONTAINING NOT MORE THAN 10% OF MATERIAL THAT WILL PASS A  $\frac{3}{8}$ " (4MM) SIEVE (NBC 9.14.3.3.4.)

**BEST PRACTICE:** FOOTING BARRIER MEMBRANE AS CAPILLARY BREAK BETWEEN FOOTING & FOUNDATION WALL

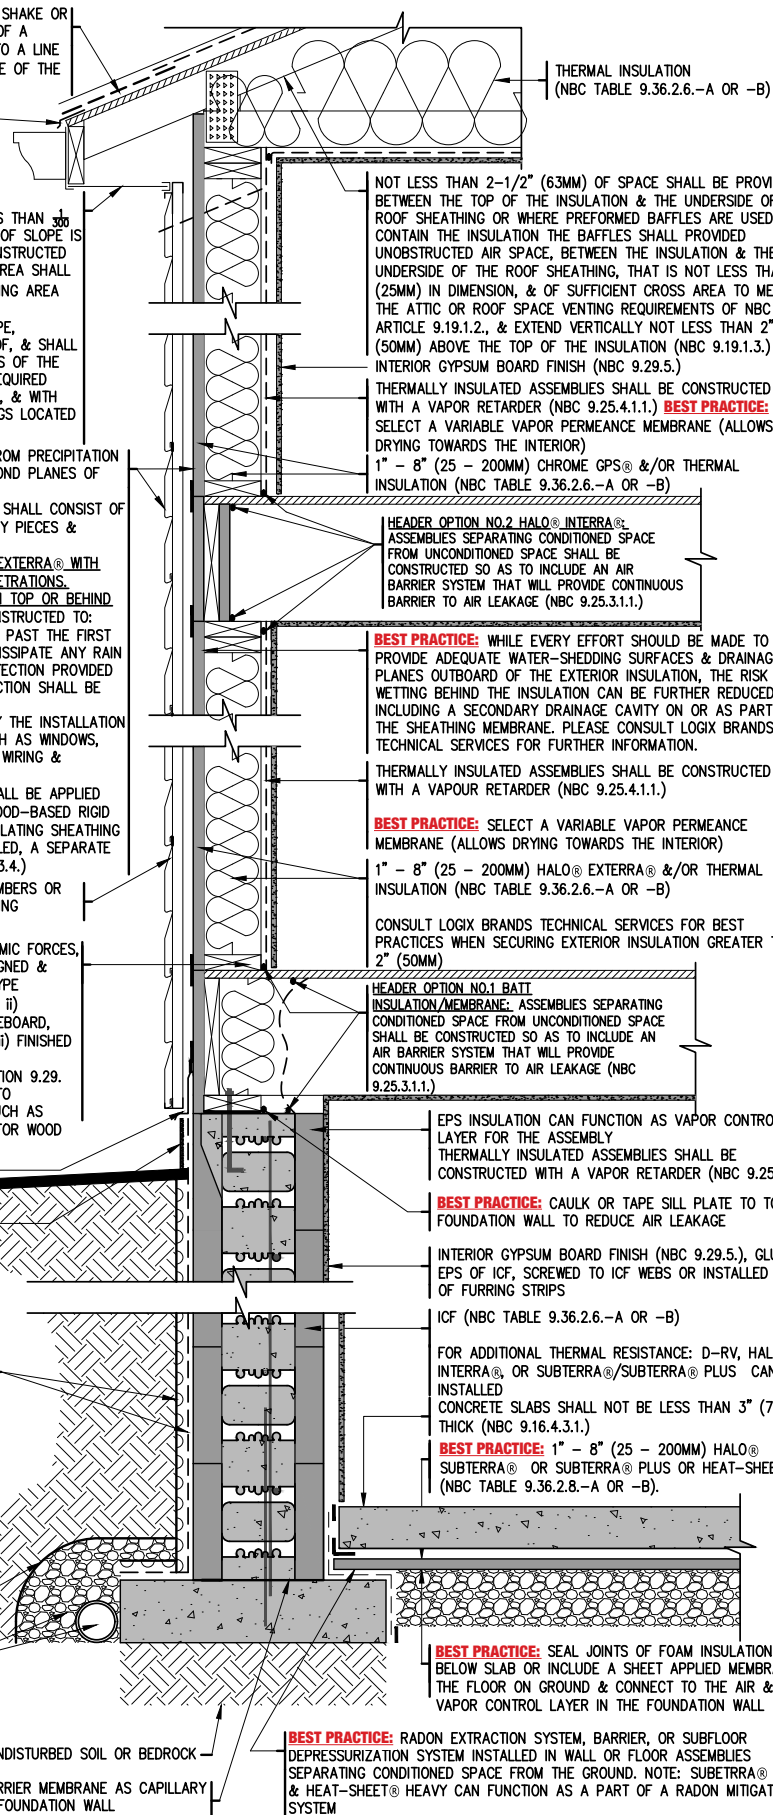

← THERMAL INSULATION (NBC TABLE 9.36.2.6.-A OR -B)

NOT LESS THAN 2-1/2" (63MM) OF SPACE SHALL BE PROVIDED BETWEEN THE TOP OF THE INSULATION & THE UNDERSIDE OF THE ROOF SHEATHING OR WHERE PREFORMED BAFFLES ARE USED TO CONTAIN THE INSULATION THE BAFFLES SHALL PROVIDED UNOBSTRUCTED AIR SPACE, BETWEEN THE INSULATION & THE UNDERSIDE OF THE ROOF SHEATHING, THAT IS NOT LESS THAN 1" (25MM) IN DIMENSION, & OF SUFFICIENT CROSS AREA TO MEET THE ATTIC OR ROOF SPACE VENTING REQUIREMENTS OF NBC ARTICLE 9.19.1.2., & EXTEND VERTICALLY NOT LESS THAN 2" (50MM) ABOVE THE TOP OF THE INSULATION (NBC 9.19.1.3.)

← INTERIOR GYPSUM BOARD FINISH (NBC 9.29.5.)

← THERMALLY INSULATED ASSEMBLIES SHALL BE CONSTRUCTED WITH A VAPOR RETARDER (NBC 9.25.4.1.1.) **BEST PRACTICE:** SELECT A VARIABLE VAPOR PERMEANCE MEMBRANE (ALLOWS DRYING TOWARDS THE INTERIOR)

← 1" - 8" (25 - 200MM) CHROME GPS® &/OR THERMAL INSULATION (NBC TABLE 9.36.2.6.-A OR -B)

← HEADER OPTION NO.2 HALO® INTERRA®, ASSEMBLIES SEPARATING CONDITIONED SPACE FROM UNCONDITIONED SPACE SHALL BE CONSTRUCTED SO AS TO INCLUDE AN AIR BARRIER SYSTEM THAT WILL PROVIDE CONTINUOUS BARRIER TO AIR LEAKAGE (NBC 9.25.3.1.1.)

**BEST PRACTICE:** WHILE EVERY EFFORT SHOULD BE MADE TO PROVIDE ADEQUATE WATER-SHEDDING SURFACES & DRAINAGE PLANES OUTBOARD OF THE EXTERIOR INSULATION, THE RISK OF WETTING BEHIND THE INSULATION CAN BE FURTHER REDUCED BY INCLUDING A SECONDARY DRAINAGE CAVITY ON OR AS PART OF THE SHEATHING MEMBRANE. PLEASE CONSULT LOGIX BRANDS TECHNICAL SERVICES FOR FURTHER INFORMATION.

← THERMALLY INSULATED ASSEMBLIES SHALL BE CONSTRUCTED WITH A VAPOUR RETARDER (NBC 9.25.4.1.1.)

**BEST PRACTICE:** SELECT A VARIABLE VAPOR PERMEANCE MEMBRANE (ALLOWS DRYING TOWARDS THE INTERIOR)

← 1" - 8" (25 - 200MM) HALO® EXTERRA® &/OR THERMAL INSULATION (NBC TABLE 9.36.2.6.-A OR -B)

← CONSULT LOGIX BRANDS TECHNICAL SERVICES FOR BEST PRACTICES WHEN SECURING EXTERIOR INSULATION GREATER THAN 2" (50MM)

← HEADER OPTION NO.1 BAIT INSULATION/MEMBRANE: ASSEMBLIES SEPARATING CONDITIONED SPACE FROM UNCONDITIONED SPACE SHALL BE CONSTRUCTED SO AS TO INCLUDE AN AIR BARRIER SYSTEM THAT WILL PROVIDE CONTINUOUS BARRIER TO AIR LEAKAGE (NBC 9.25.3.1.1.)

← EPS INSULATION CAN FUNCTION AS VAPOR CONTROL LAYER FOR THE ASSEMBLY THERMALLY INSULATED ASSEMBLIES SHALL BE CONSTRUCTED WITH A VAPOR RETARDER (NBC 9.25.4.1.1.)

**BEST PRACTICE:** CAULK OR TAPE SILL PLATE TO TOP OF FOUNDATION WALL TO REDUCE AIR LEAKAGE

← INTERIOR GYPSUM BOARD FINISH (NBC 9.29.5.), GLUED TO EPS OF ICF, SCREWED TO ICF WEBS OR INSTALLED ONTOP OF FURRING STRIPS

← ICF (NBC TABLE 9.36.2.6.-A OR -B)

← FOR ADDITIONAL THERMAL RESISTANCE: D-RV, HALO® INTERRA®, OR SUBTERRA®/SUBTERRA® PLUS CAN BE INSTALLED CONCRETE SLABS SHALL NOT BE LESS THAN 3" (75MM) THICK (NBC 9.16.4.3.1.)

**BEST PRACTICE:** 1" - 8" (25 - 200MM) HALO® SUBTERRA® OR SUBTERRA® PLUS OR HEAT-SHEET® (NBC TABLE 9.36.2.8.-A OR -B).

**BEST PRACTICE:** SEAL JOINTS OF FOAM INSULATION BELOW SLAB OR INCLUDE A SHEET APPLIED MEMBRANE IN THE FLOOR ON GROUND & CONNECT TO THE AIR &/OR VAPOR CONTROL LAYER IN THE FOUNDATION WALL

**BEST PRACTICE:** RADON EXTRACTION SYSTEM, BARRIER, OR SUBFLOOR DEPRESSURIZATION SYSTEM INSTALLED IN WALL OR FLOOR ASSEMBLIES SEPARATING CONDITIONED SPACE FROM THE GROUND. NOTE: SUBTERRA® PLUS & HEAT-SHEET® HEAVY CAN FUNCTION AS A PART OF A RADON MITIGATION SYSTEM

EAVE PROTECTION SHALL BE PROVIDED ON SHINGLE, SHAKE OR TILE ROOFS, EXTENDING FROM THE EDGE OF THE ROOF A MINIMUM OF 36" (900MM) UP TO THE ROOF SLOPE TO A LINE NOT LESS THAN 12" (300MM) INSIDE THE INNER FACE OF THE EXTERIOR WALL (NBC 9.26.5.1.)

**BEST PRACTICE:** DRIP EDGE AT EAVE OF ROOF

**ROOF VENTING REQUIREMENTS**

- UNOBSTRUCTED VENT AREA SHALL NOT BE LESS THAN 1/30 OF THE INSULATED CEILING AREA OR WHERE ROOF SLOPE IS LESS THAN 1 IN 6 OR IN ROOFS THAT ARE CONSTRUCTED WITH ROOF JOISTS, THE UNOBSTRUCTED VENT AREA SHALL BE NOT LESS THAN 1/50 OF THE INSULATED CEILING AREA (NBC 9.19.1.1.)
- REQUIRED VENTS MAY BE ROOF TYPE, EAVE TYPE, GABLE-END TYPE OF ANY COMBINATION THEREOF, & SHALL BE DISTRIBUTED: UNIFORMLY ON OPPOSITE SIDES OF THE BUILDING, WITH NOT LESS THAN 25% OF THE REQUIRED OPENINGS LOCATED AT THE TOP OF THE SPACE, & WITH NOT LESS THAN 25% OF THE REQUIRED OPENINGS LOCATED AT THE BOTTOM OF THE SPACE (NBC 9.19.1.2.)

WHERE WALLS REQUIRED TO PROVIDE PROTECTION FROM PRECIPITATION COMPRISE CLADDING ASSEMBLIES WITH FIRST & SECOND PLANES OF PROTECTION,

- THE FIRST PLANE OF PROTECTION (CLADDING) SHALL CONSIST OF CLADDING WITH APPROPRIATE TRIM, ACCESSORY PIECES & FASTENERS
- THE SECOND PLANE OF PROTECTION (MECHANICALLY FASTENED, SELF-ADHERED, OR LIQUID APPLIED MEMBRANE (VAPOR PERMEABLE) APPLIED ON TOP OF EXTERIOR SHEATHING) SHALL BE DESIGNED & CONSTRUCTED TO:
  - INTERCEPT ALL RAIN & SNOW THAT GETS PAST THE FIRST PLANE OF PROTECTION, & EFFECTIVELY DISSIPATE ANY RAIN OR SNOW TO THE EXTERIOR, & THE PROTECTION PROVIDED BY THE FIRST & SECOND PLANES PROTECTION SHALL BE MAINTAINED
  - AT WALL PENETRATIONS CREATED BY THE INSTALLATION OF COMPONENTS AND SERVICES SUCH AS WINDOWS, DOORS, VENTILATION DUCTS, PIPING, WIRING & ELECTRICAL OUTLETS (NBC 9.27.2.3.)

AT LEAST ONE LAYER OF SHEATHING MEMBRANE SHALL BE APPLIED BENEATH CLADDING (NBC 9.27.3.3.) CLADDING SHALL BE FASTENED TO THE FRAMING MEMBERS OR FURRING MEMBERS, OR TO BLOCKING BETWEEN FRAMING MEMBERS (NBC 9.27.5.1.)

REQUIREMENTS FOR LOW TO MODERATE WIND & SEISMIC FORCES, BRACING TO RESIST LATERAL LOADS SHALL BE DESIGNED & CONSTRUCTED AS FOLLOWS: i) CLAD WITH PANEL-TYPE CLADDING IN ACCORDANCE WITH NBC SECTION 9.27., ii) SHEATHING WITH PLYWOOD, OSB, WAFERBOARD, FIBREBOARD, GYPSUM BOARD OR DIAGONAL LUMBER SHEATHING, iii) FINISHED ON THE INTERIOR WITH A PANEL-TYPE MATERIAL IN ACCORDANCE WITH THE REQUIREMENTS OF NBC SECTION 9.29. OR IN ACCORDANCE WITH NBC ARTICLES 9.23.13.4. TO 9.23.13.7., PART 4, GOOD ENGINEERING PRACTICE SUCH AS THAT PROVIDED IN CWC 2014, "ENGINEERING GUIDE FOR WOOD FRAME CONSTRUCTION" (NBC 9.23.13.1.)

**BEST PRACTICE:** BUG SCREEN TOP & BOTTOM OF VENTILATED AIR SPACE

EXTERIOR FOUNDATION WALLS SHALL EXTEND NOT LESS THAN 6" (150MM) ABOVE FINISHED GROUND LEVEL (NBC 9.15.4.6.) INSULATION ABOVE GRADE CANNOT BE LEFT EXPOSED COVER WITH ACRYLIC PARGING (NBC 9.25.2.3. 6) 7), OPTIONAL: GYPSUM OR CONCRETE BOARD


WHERE THE EXTERIOR FINISHED GROUND LEVEL IS AT A HIGHER ELEVATION THAN THE GROUND LEVEL INSIDE THE FOUNDATION WALLS, EXTERIOR SURFACES OF FOUNDATION WALLS BELOW GROUND LEVEL SHALL BE DAMPROOFED (NBC 9.13.2.1.) **BEST PRACTICE:** PEEL & STICK OR LIQUID APPLIED NON-PERMEABLE MEMBRANE APPLIED TO ICF BLOCK PRIOR TO DRAINAGE LAYER

DRAINAGE LAYER SHALL BE INSTALLED: MINERAL FIBRE INSULATION OR GRANULAR MATERIAL OR A SYSTEM THAT PROVIDES EQUIVALENT PERFORMANCE (NBC 9.14.2.1.)

**BEST PRACTICE:** COVER GRANULAR FILL WITH FABRIC CLOTH

MIN. 4" (100MM) DIAM. DRAIN TILE OR PIPE (NBC 9.14.3.2.) COVERED WITH NOT LESS THAN 6" (150MM) CRUSHED STONE OR OTHER COARSE CLEAN GRANULAR MATERIAL CONTAINING NOT MORE THAN 10% OF MATERIAL THAT WILL PASS A 8" (4MM) SIEVE (NBC 9.14.3.3.4.)

**BEST PRACTICE:** FOOTING BARRIER MEMBRANE AS CAPILLARY BREAK BETWEEN FOOTING & FOUNDATION WALL

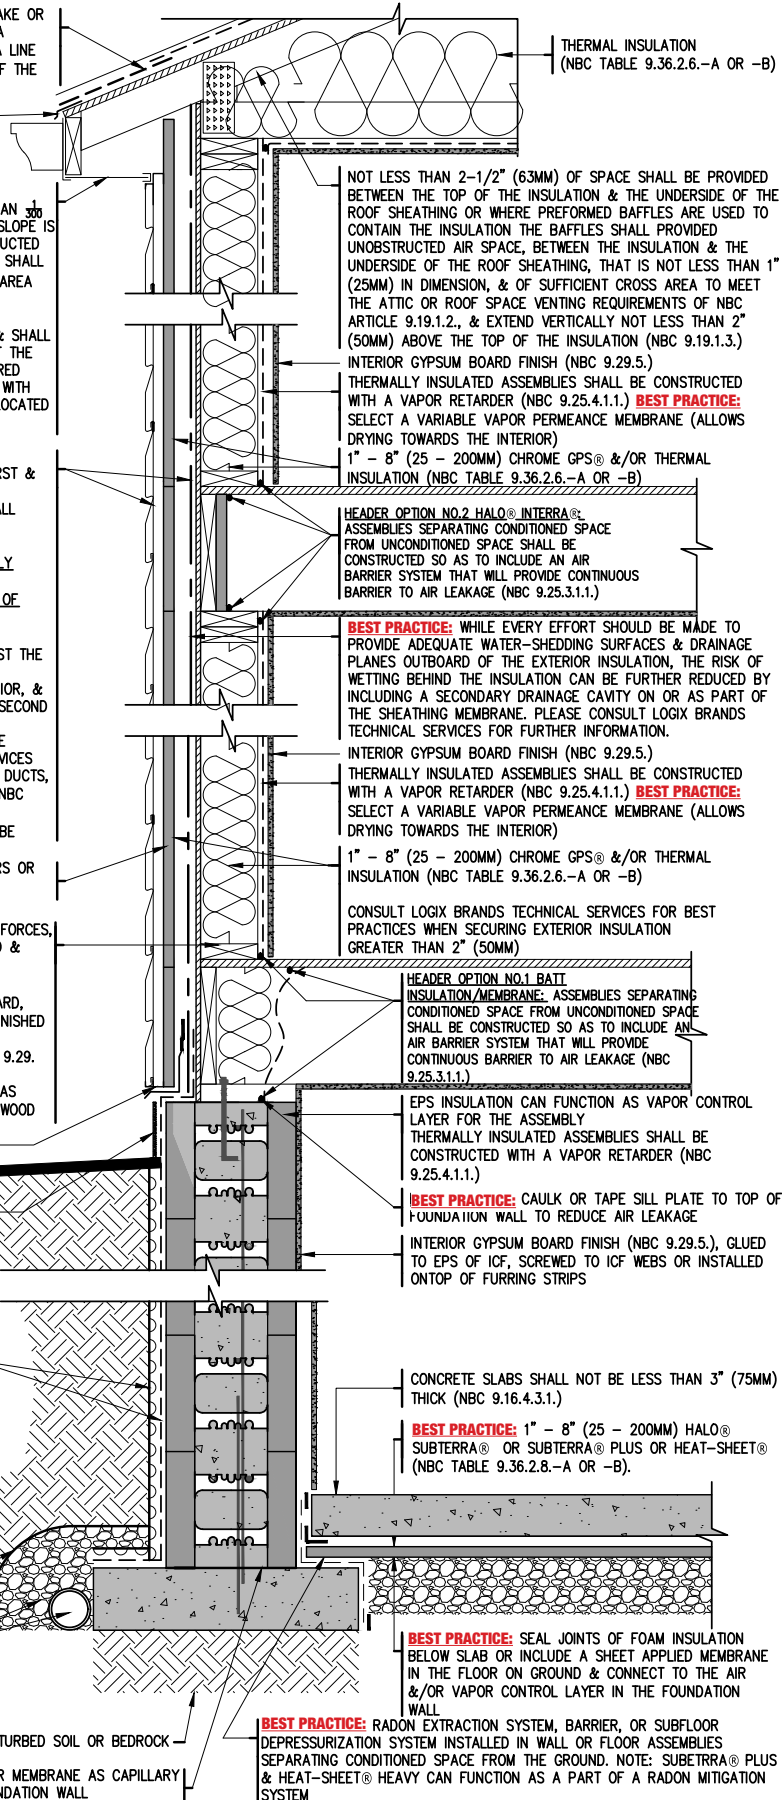

THERMAL INSULATION (NBC TABLE 9.36.2.6.-A OR -B)

NOT LESS THAN 2-1/2" (63MM) OF SPACE SHALL BE PROVIDED BETWEEN THE TOP OF THE INSULATION & THE UNDERSIDE OF THE ROOF SHEATHING OR WHERE PERFORMED BAFFLES ARE USED TO CONTAIN THE INSULATION THE BAFFLES SHALL PROVIDED UNOBSTRUCTED AIR SPACE, BETWEEN THE INSULATION & THE UNDERSIDE OF THE ROOF SHEATHING, THAT IS NOT LESS THAN 1" (25MM) IN DIMENSION, & OF SUFFICIENT CROSS AREA TO MEET THE ATTIC OR ROOF SPACE VENTING REQUIREMENTS OF NBC ARTICLE 9.19.1.2., & EXTEND VERTICALLY NOT LESS THAN 2" (50MM) ABOVE THE TOP OF THE INSULATION (NBC 9.19.1.3.)

INTERIOR GYPSUM BOARD FINISH (NBC 9.29.5.) THERMALLY INSULATED ASSEMBLIES SHALL BE CONSTRUCTED WITH A VAPOR RETARDER (NBC 9.25.4.1.1.) **BEST PRACTICE:** SELECT A VARIABLE VAPOR PERMEANCE MEMBRANE (ALLOWS DRYING TOWARDS THE INTERIOR) 1" - 8" (25 - 200MM) CHROME GPS® &/OR THERMAL INSULATION (NBC TABLE 9.36.2.6.-A OR -B)

HEADER OPTION NO.2 HALO® INTERRA® ASSEMBLIES SEPARATING CONDITIONED SPACE FROM UNCONDITIONED SPACE SHALL BE CONSTRUCTED SO AS TO INCLUDE AN AIR BARRIER SYSTEM THAT WILL PROVIDE CONTINUOUS BARRIER TO AIR LEAKAGE (NBC 9.25.3.1.1.)

**BEST PRACTICE:** WHILE EVERY EFFORT SHOULD BE MADE TO PROVIDE ADEQUATE WATER-SHEDDING SURFACES & DRAINAGE PLANES OUTBOARD OF THE EXTERIOR INSULATION, THE RISK OF WETTING BEHIND THE INSULATION CAN BE FURTHER REDUCED BY INCLUDING A SECONDARY DRAINAGE CAVITY ON OR AS PART OF THE SHEATHING MEMBRANE. PLEASE CONSULT LOGIX BRANDS TECHNICAL SERVICES FOR FURTHER INFORMATION.

INTERIOR GYPSUM BOARD FINISH (NBC 9.29.5.) THERMALLY INSULATED ASSEMBLIES SHALL BE CONSTRUCTED WITH A VAPOR RETARDER (NBC 9.25.4.1.1.) **BEST PRACTICE:** SELECT A VARIABLE VAPOR PERMEANCE MEMBRANE (ALLOWS DRYING TOWARDS THE INTERIOR)

1" - 8" (25 - 200MM) CHROME GPS® &/OR THERMAL INSULATION (NBC TABLE 9.36.2.6.-A OR -B)

CONSULT LOGIX BRANDS TECHNICAL SERVICES FOR BEST PRACTICES WHEN SECURING EXTERIOR INSULATION GREATER THAN 2" (50MM)

HEADER OPTION NO.1 BATT INSULATION/MEMBRANE. ASSEMBLIES SEPARATING CONDITIONED SPACE FROM UNCONDITIONED SPACE SHALL BE CONSTRUCTED SO AS TO INCLUDE AN AIR BARRIER SYSTEM THAT WILL PROVIDE CONTINUOUS BARRIER TO AIR LEAKAGE (NBC 9.25.3.1.1.)

EPS INSULATION CAN FUNCTION AS VAPOR CONTROL LAYER FOR THE ASSEMBLY THERMALLY INSULATED ASSEMBLIES SHALL BE CONSTRUCTED WITH A VAPOR RETARDER (NBC 9.25.4.1.1.)

**BEST PRACTICE:** CAULK OR TAPE SILL PLATE TO TOP OF FOUNDATION WALL TO REDUCE AIR LEAKAGE

INTERIOR GYPSUM BOARD FINISH (NBC 9.29.5.), GLUED TO EPS OF ICF, SCREWED TO ICF WEBS OR INSTALLED ON TOP OF FURRING STRIPS

CONCRETE SLABS SHALL NOT BE LESS THAN 3" (75MM) THICK (NBC 9.16.4.3.1.)

**BEST PRACTICE:** 1" - 8" (25 - 200MM) HALO® SUBTERRA® OR SUBTERRA® PLUS OR HEAT-SHEET® (NBC TABLE 9.36.2.8.-A OR -B).

**BEST PRACTICE:** SEAL JOINTS OF FOAM INSULATION BELOW SLAB OR INCLUDE A SHEET APPLIED MEMBRANE IN THE FLOOR ON GROUND & CONNECT TO THE AIR &/OR VAPOR CONTROL LAYER IN THE FOUNDATION WALL

**BEST PRACTICE:** RADON EXTRACTION SYSTEM, BARRIER, OR SUBFLOOR DEPRESSURIZATION SYSTEM INSTALLED IN WALL OR FLOOR ASSEMBLIES SEPARATING CONDITIONED SPACE FROM THE GROUND. NOTE: SUBTERRA® PLUS & HEAT-SHEET® HEAVY CAN FUNCTION AS A PART OF A RADON MITIGATION SYSTEM

EAVE PROTECTION SHALL BE PROVIDED ON SHINGLE, SHAKE OR TILE ROOFS, EXTENDING FROM THE EDGE OF THE ROOF A MINIMUM OF 36" (900MM) UP TO THE ROOF SLOPE TO A LINE NOT LESS THAN 12" (300MM) INSIDE THE INNER FACE OF THE EXTERIOR WALL (NBC 9.26.5.1.)

**BEST PRACTICE:** DRIP EDGE AT EAVE OF ROOF

**BEST PRACTICE:** STRUCTURAL FOAM BOARD INSULATION ON TOP OF ICF WALL TO PREVENT THERMAL BRIDGE

**ROOF VENTING REQUIREMENTS**

- UNOBSTRUCTED VENT AREA SHALL NOT BE LESS THAN  $\frac{1}{300}$  OF THE INSULATED CEILING AREA OR WHERE ROOF SLOPE IS LESS THAN 1 IN 6 OR IN ROOFS THAT ARE CONSTRUCTED WITH ROOF JOISTS, THE UNOBSTRUCTED VENT AREA SHALL BE NOT LESS THAN  $\frac{1}{100}$  OF THE INSULATED CEILING AREA (NBC 9.19.1.1.)
- REQUIRED VENTS MAY BE ROOF TYPE, EAVE TYPE, GABLE-END TYPE OF ANY COMBINATION THEREOF, & SHALL BE DISTRIBUTED: UNIFORMLY ON OPPOSITE SIDES OF THE BUILDING, WITH NOT LESS THAN 25% OF THE REQUIRED OPENINGS LOCATED AT THE TOP OF THE SPACE, & WITH NOT LESS THAN 25% OF THE REQUIRED OPENINGS LOCATED AT THE BOTTOM OF THE SPACE (NBC 9.19.1.2.)

WHERE WALLS REQUIRED TO PROVIDE PROTECTION FROM PRECIPITATION COMPRISE CLADDING ASSEMBLIES WITH FIRST & SECOND PLANES OF PROTECTION,

- THE FIRST PLANE OF PROTECTION (CLADDING) SHALL CONSIST OF CLADDING WITH APPROPRIATE TRIM, ACCESSORY PIECES & FASTENERS
- THE SECOND PLANE OF PROTECTION (FRONT FACE OF ICF, ALTERNATIVE DETAIL - MECH. FASTENED, PEEL & STICK, OR LIQUID APPLIED MEMBRANE APPLIED TO FRONT FACE OF ICF BLOCK) SHALL BE DESIGNED & CONSTRUCTED TO:
  - INTERCEPT ALL RAIN & SNOW THAT GETS PAST THE FIRST PLANE OF PROTECTION, & EFFECTIVELY DISSIPATE ANY RAIN OR SNOW TO THE EXTERIOR, & THE PROTECTION PROVIDED BY THE FIRST & SECOND PLANES PROTECTION SHALL BE MAINTAINED
  - AT WALL PENETRATIONS CREATED BY THE INSTALLATION OF COMPONENTS AND SERVICES SUCH AS WINDOWS, DOORS, VENTILATION DUCTS, PIPING, WIRING & ELECTRICAL OUTLETS (NBC 9.27.2.3.)

FLASHING SEALED TO FRONT FACE OF ICF

**BEST PRACTICE:** BUG SCREEN TOP & BOTTOM OF VENTILATED AIR SPACE

EXTERIOR FOUNDATION WALLS SHALL EXTEND NOT LESS THAN 6" (150MM) ABOVE FINISHED GROUND LEVEL (NBC 9.15.4.6.)

INSULATION ABOVE GRADE CANNOT BE LEFT EXPOSED COVER WITH ACRYLIC PARGING (NBC 9.25.2.3. 6) 7), OPTIONAL: GYPSUM OR CONCRETE BOARD


WHERE THE EXTERIOR FINISHED GROUND LEVEL IS AT A HIGHER ELEVATION THAN THE GROUND LEVEL INSIDE THE FOUNDATION WALLS, EXTERIOR SURFACES OF FOUNDATION WALLS BELOW GROUND LEVEL SHALL BE DAMPPROOFED (NBC 9.13.2.1.). **BEST PRACTICE:** PEEL & STICK OR LIQUID APPLIED NON-PERMEABLE MEMBRANE APPLIED TO ICF BLOCK PRIOR TO DRAINAGE LAYER

DRAINAGE LAYER SHALL BE INSTALLED: MINERAL FIBRE INSULATION OR GRANULAR MATERIAL OR A SYSTEM THAT PROVIDES EQUIVALENT PERFORMANCE (NBC 9.14.2.1.)

**BEST PRACTICE:** COVER GRANULAR FILL WITH FABRIC CLOTH

MIN. 4" (100MM) DIAM. DRAIN TILE OR PIPE (NBC 9.14.3.2.) COVERED WITH NOT LESS THAN 6" (150MM) CRUSHED STONE OR OTHER COARSE CLEAN GRANULAR MATERIAL CONTAINING NOT MORE THAN 10% OF MATERIAL THAT WILL PASS A  $\frac{1}{8}$ " (4MM) SIEVE (NBC 9.14.3.3.4.)

**BEST PRACTICE:** FOOTING BARRIER MEMBRANE AS CAPILLARY BREAK BETWEEN FOOTING & FOUNDATION WALL

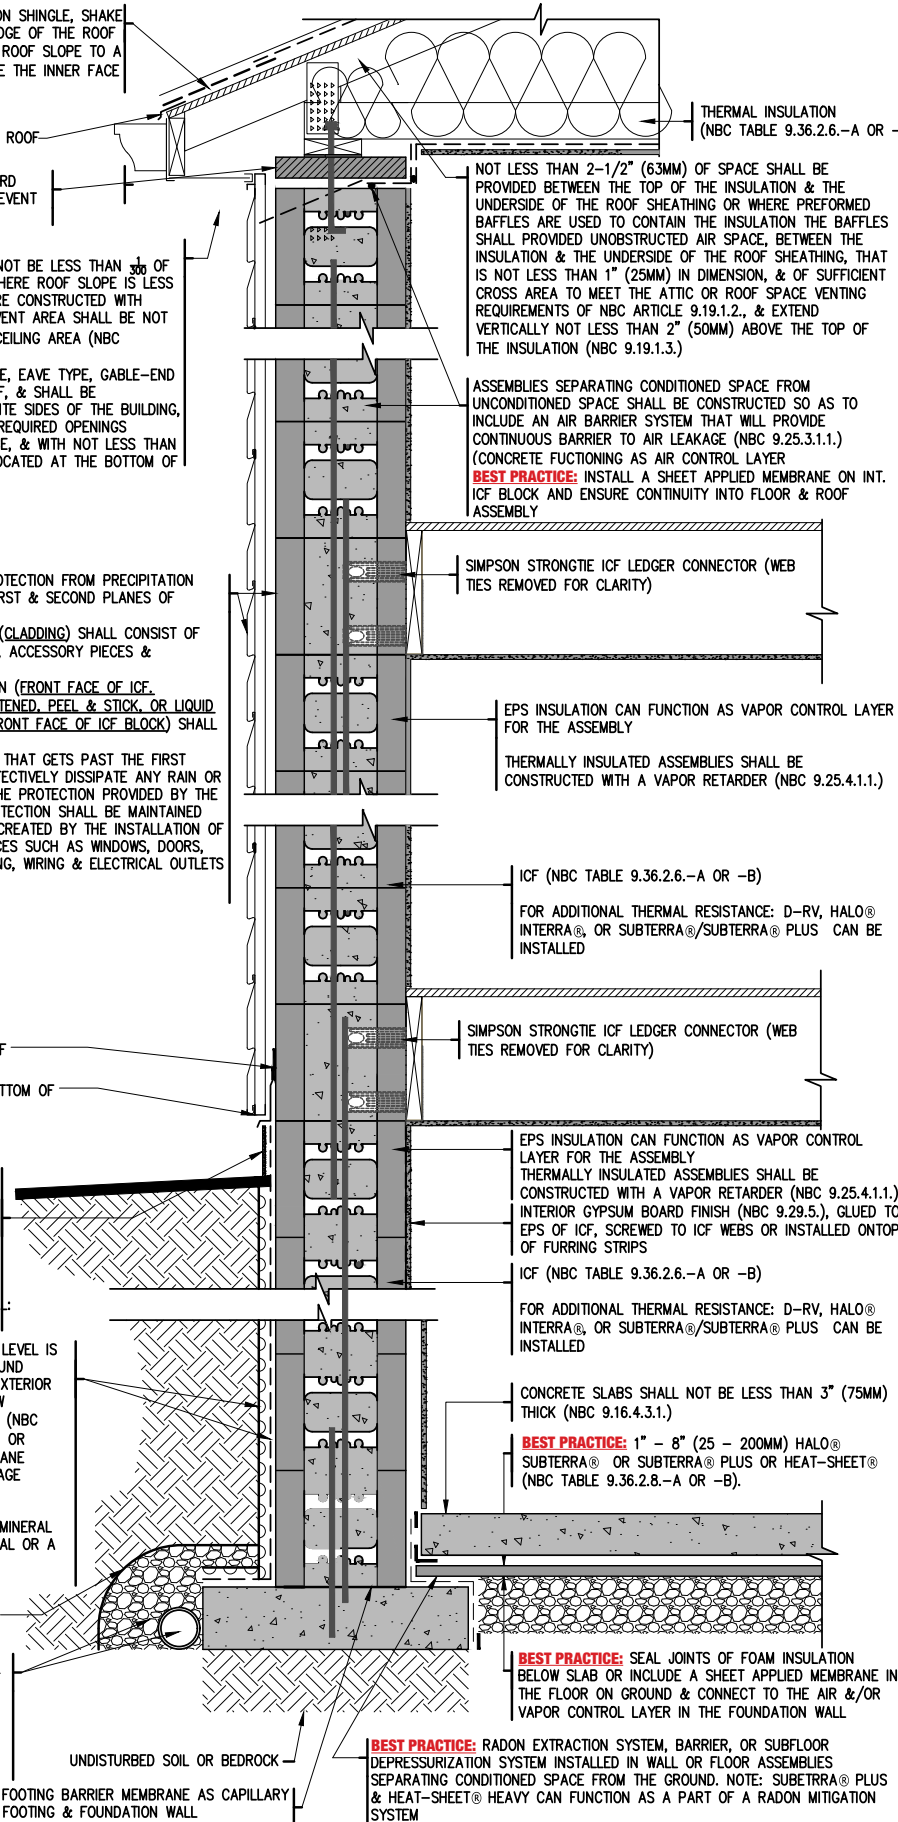

THERMAL INSULATION (NBC TABLE 9.36.2.6.-A OR -B)

NOT LESS THAN 2-1/2" (63MM) OF SPACE SHALL BE PROVIDED BETWEEN THE TOP OF THE INSULATION & THE UNDERSIDE OF THE ROOF SHEATHING OR WHERE PREFORMED BAFFLES ARE USED TO CONTAIN THE INSULATION THE BAFFLES SHALL PROVIDED UNOBSTRUCTED AIR SPACE, BETWEEN THE INSULATION & THE UNDERSIDE OF THE ROOF SHEATHING, THAT IS NOT LESS THAN 1" (25MM) IN DIMENSION, & OF SUFFICIENT CROSS AREA TO MEET THE ATTIC OR ROOF SPACE VENTING REQUIREMENTS OF NBC ARTICLE 9.19.1.2., & EXTEND VERTICALLY NOT LESS THAN 2" (50MM) ABOVE THE TOP OF THE INSULATION (NBC 9.19.1.3.)

ASSEMBLIES SEPARATING CONDITIONED SPACE FROM UNCONDITIONED SPACE SHALL BE CONSTRUCTED SO AS TO INCLUDE AN AIR BARRIER SYSTEM THAT WILL PROVIDE CONTINUOUS BARRIER TO AIR LEAKAGE (NBC 9.25.3.1.1.) (CONCRETE FUNCTIONING AS AIR CONTROL LAYER)  
**BEST PRACTICE:** INSTALL A SHEET APPLIED MEMBRANE ON INT. ICF BLOCK AND ENSURE CONTINUITY INTO FLOOR & ROOF ASSEMBLY

SIMPSON STRONGTIE ICF LEDGER CONNECTOR (WEB TIES REMOVED FOR CLARITY)

EPS INSULATION CAN FUNCTION AS VAPOR CONTROL LAYER FOR THE ASSEMBLY

THERMALLY INSULATED ASSEMBLIES SHALL BE CONSTRUCTED WITH A VAPOR RETARDER (NBC 9.25.4.1.1.)

ICF (NBC TABLE 9.36.2.6.-A OR -B)

FOR ADDITIONAL THERMAL RESISTANCE: D-RV, HALO® INTERRA®, OR SUBTERRA®/SUBTERRA® PLUS CAN BE INSTALLED

SIMPSON STRONGTIE ICF LEDGER CONNECTOR (WEB TIES REMOVED FOR CLARITY)

EPS INSULATION CAN FUNCTION AS VAPOR CONTROL LAYER FOR THE ASSEMBLY  
THERMALLY INSULATED ASSEMBLIES SHALL BE CONSTRUCTED WITH A VAPOR RETARDER (NBC 9.25.4.1.1.)  
INTERIOR GYPSUM BOARD FINISH (NBC 9.29.5.), GLUED TO EPS OF ICF, SCREWED TO ICF WEBS OR INSTALLED ONTOP OF FURRING STRIPS

ICF (NBC TABLE 9.36.2.6.-A OR -B)

FOR ADDITIONAL THERMAL RESISTANCE: D-RV, HALO® INTERRA®, OR SUBTERRA®/SUBTERRA® PLUS CAN BE INSTALLED

CONCRETE SLABS SHALL NOT BE LESS THAN 3" (75MM) THICK (NBC 9.16.4.3.1.)

**BEST PRACTICE:** 1" - 8" (25 - 200MM) HALO® SUBTERRA® OR SUBTERRA® PLUS OR HEAT-SHEET® (NBC TABLE 9.36.2.8.-A OR -B).

**BEST PRACTICE:** SEAL JOINTS OF FOAM INSULATION BELOW SLAB OR INCLUDE A SHEET APPLIED MEMBRANE IN THE FLOOR ON GROUND & CONNECT TO THE AIR &/OR VAPOR CONTROL LAYER IN THE FOUNDATION WALL

**BEST PRACTICE:** RADON EXTRACTION SYSTEM, BARRIER, OR SUBFLOOR DEPRESSURIZATION SYSTEM INSTALLED IN WALL OR FLOOR ASSEMBLIES SEPARATING CONDITIONED SPACE FROM THE GROUND. NOTE: SUBTERRA® PLUS & HEAT-SHEET® HEAVY CAN FUNCTION AS A PART OF A RADON MITIGATION SYSTEM

EAVE PROTECTION SHALL BE PROVIDED ON SHINGLE, SHAKE OR TILE ROOFS, EXTENDING FROM THE EDGE OF THE ROOF A MINIMUM OF 36" (900MM) UP TO THE ROOF SLOPE TO A LINE NOT LESS THAN 12" (300MM) INSIDE THE INNER FACE OF THE EXTERIOR WALL (NBC 9.26.5.1.)

**BEST PRACTICE:** DRIP EDGE AT EAVE OF ROOF

**ROOF VENTING REQUIREMENTS**

- UNOBSTRUCTED VENT AREA SHALL NOT BE LESS THAN  $\frac{1}{300}$  OF THE INSULATED CEILING AREA OR WHERE ROOF SLOPE IS LESS THAN 1 IN 6 OR IN ROOFS THAT ARE CONSTRUCTED WITH ROOF JOISTS, THE UNOBSTRUCTED VENT AREA SHALL BE NOT LESS THAN  $\frac{1}{150}$  OF THE INSULATED CEILING AREA (NBC 9.19.1.1.)
- REQUIRED VENTS MAY BE ROOF TYPE, EAVE TYPE, GABLE-END TYPE OF ANY COMBINATION THEREOF, & SHALL BE DISTRIBUTED: UNIFORMLY ON OPPOSITE SIDES OF THE BUILDING, WITH NOT LESS THAN 25% OF THE REQUIRED OPENINGS LOCATED AT THE TOP OF THE SPACE, & WITH NOT LESS THAN 25% OF THE REQUIRED OPENINGS LOCATED AT THE BOTTOM OF THE SPACE (NBC 9.19.1.2.)

WHERE WALLS REQUIRED TO PROVIDE PROTECTION FROM PRECIPITATION COMPRISE CLADDING ASSEMBLIES WITH FIRST & SECOND PLANES OF PROTECTION,

- THE FIRST PLANE OF PROTECTION (CLADDING) SHALL CONSIST OF CLADDING WITH APPROPRIATE TRIM, ACCESSORY PIECES & FASTENERS
- THE SECOND PLANE OF PROTECTION (HALO® EXTERRA® WITH TAPED OR CAULKED JOINTS & FASTENER PENETRATIONS, ALTERNATIVE DETAIL, MEMBRANE INSTALLED ON TOP OR BEHIND RIGID INSULATION) SHALL BE DESIGNED & CONSTRUCTED TO:

--- INTERCEPT ALL RAIN & SNOW THAT GETS PAST THE FIRST PLANE OF PROTECTION, & EFFECTIVELY DISSIPATE ANY RAIN OR SNOW TO THE EXTERIOR, & THE PROTECTION PROVIDED BY THE FIRST & SECOND PLANES PROTECTION SHALL BE MAINTAINED

--- AT WALL PENETRATIONS CREATED BY THE INSTALLATION OF COMPONENTS AND SERVICES SUCH AS WINDOWS, DOORS, VENTILATION DUCTS, PIPING, WIRING & ELECTRICAL OUTLETS (NBC 9.27.2.3.)

AT LEAST ONE LAYER OF SHEATHING MEMBRANE SHALL BE APPLIED BENEATH CLADDING (NBC 9.27.3.3.), WHERE NON-WOOD-BASED RIGID EXTERIOR INSULATING SHEATHING, OR EXTERIOR INSULATING SHEATHING WITH AN INTEGRAL SHEATHING MEMBRANE IS INSTALLED, A SEPARATE SHEATHING MEMBRANE IS NOT REQUIRED (NBC 9.27.3.4.)

CLADDING SHALL BE FASTENED TO THE FRAMING MEMBERS OR FURRING MEMBERS, OR TO BLOCKING BETWEEN FRAMING MEMBERS (NBC 9.27.5.1.)

REQUIREMENTS FOR LOW TO MODERATE WIND & SEISMIC FORCES, BRACING TO RESIST LATERAL LOADS SHALL BE DESIGNED & CONSTRUCTED AS FOLLOWS: i) CLAD WITH PANEL-TYPE CLADDING IN ACCORDANCE WITH NBC SECTION 9.27., ii) SHEATHING WITH PLYWOOD, OSB, WAFFERBOARD, FIBREBOARD, GYPSUM BOARD OR DIAGONAL LUMBER SHEATHING, iii) FINISHED ON THE INTERIOR WITH A PANEL-TYPE MATERIAL IN ACCORDANCE WITH THE REQUIREMENTS OF NBC SECTION 9.29. OR IN ACCORDANCE WITH NBC ARTICLES 9.23.13.4. TO 9.23.13.7., PART 4, GOOD ENGINEERING PRACTICE SUCH AS THAT PROVIDED IN CWC 2014, "ENGINEERING GUIDE FOR WOOD FRAME CONSTRUCTION" (NBC 9.23.13.1.)

**BEST PRACTICE:** BUG SCREEN TOP & BOTTOM OF VENTILATED AIR SPACE

EXTERIOR FOUNDATION WALLS SHALL EXTEND NOT LESS THAN 6" (150MM) ABOVE FINISHED GROUND LEVEL (NBC 9.15.4.6.)

INSULATION ABOVE GRADE CANNOT BE LEFT EXPOSED COVER WITH GYPSUM OR CONCRETE BOARD & ACRYLIC PARGING (NBC 9.25.2.3. 6) 7)


WHERE THE EXTERIOR FINISHED GROUND LEVEL IS AT A HIGHER ELEVATION THAN THE GROUND LEVEL INSIDE THE FOUNDATION WALLS, EXTERIOR SURFACES OF FOUNDATION WALLS BELOW GROUND LEVEL SHALL BE DAMPROOFED (NBC 9.13.2.1.)

DRAINAGE LAYER SHALL BE INSTALLED: MINERAL FIBRE INSULATION OR GRANULAR MATERIAL OR A SYSTEM THAT PROVIDES EQUIVALENT PERFORMANCE (NBC 9.14.2.1.)

**BEST PRACTICE:** COVER GRANULAR FILL WITH FABRIC CLOTH

MIN. 4" (100MM) DIAM. DRAIN TILE OR PIPE (NBC 9.14.3.2.) COVERED WITH NOT LESS THAN 6" (150MM) CRUSHED STONE OR OTHER COARSE CLEAN GRANULAR MATERIAL CONTAINING NOT MORE THAN 10% OF MATERIAL THAT WILL PASS A  $\frac{3}{8}$ " (4MM) SIEVE (NBC 9.14.3.3.4.)

**BEST PRACTICE:** FOOTING BARRIER MEMBRANE AS CAPILLARY BREAK BETWEEN FOOTING & FOUNDATION WALL

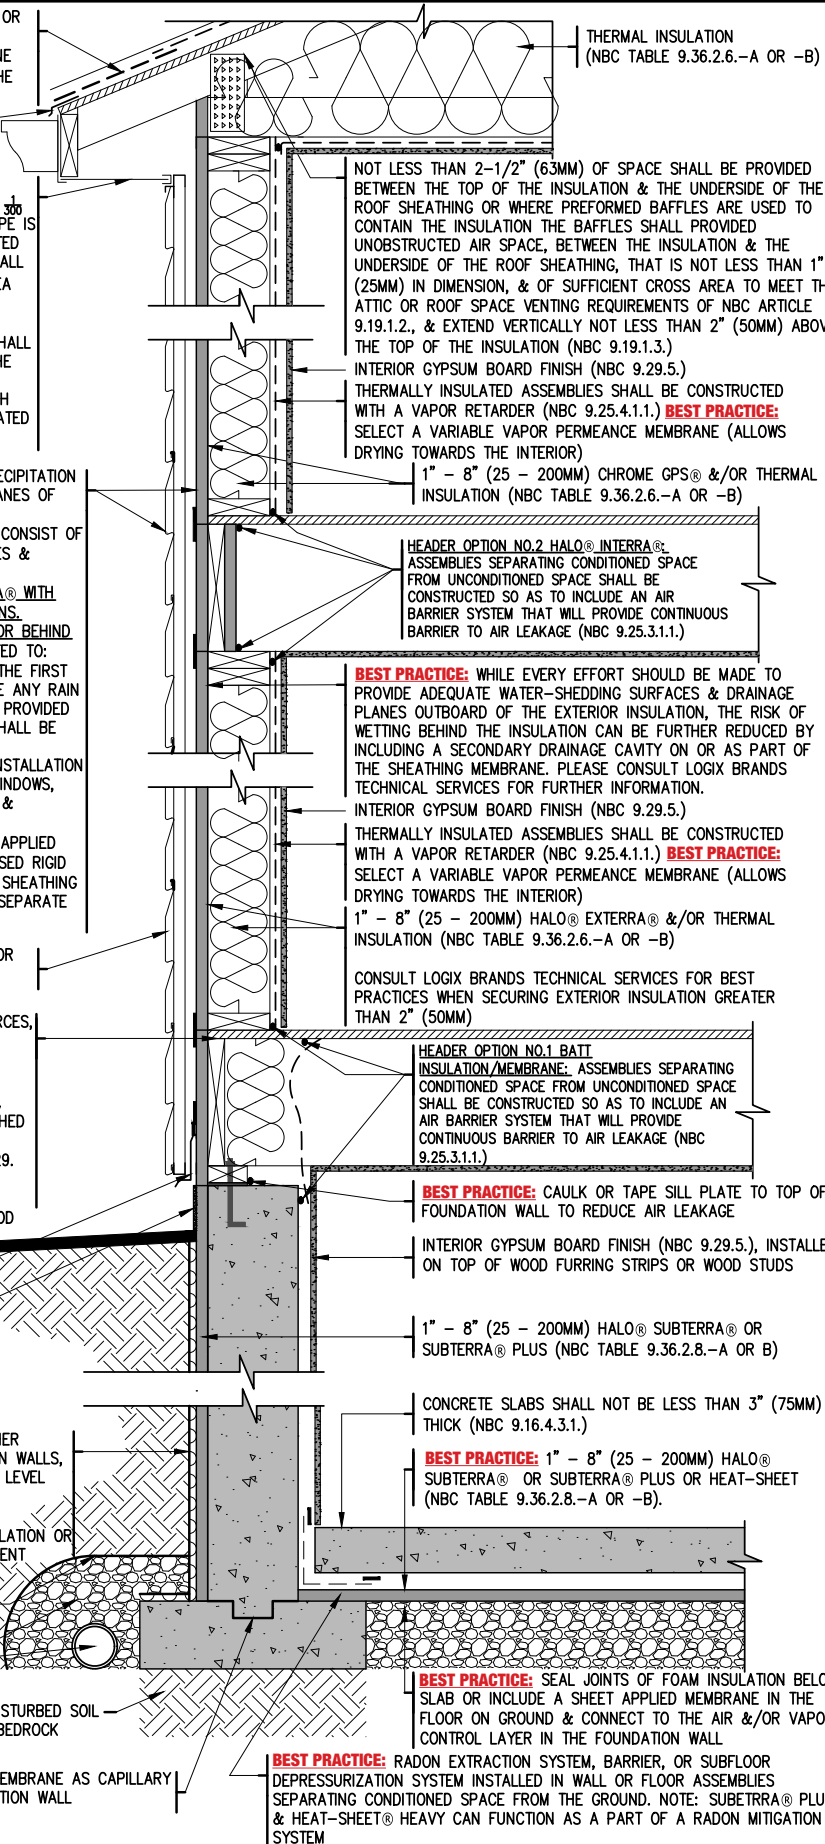

© Copyright Logix Brands Ltd. (2024) All rights reserved. No part of the work contained herein as covered by this copyright may be reproduced or used in any form, or any means - graphic, electronic or mechanical, including without limitation photocopying. By using these drawings, you agree to assume all risks associated therewith. See Logixbrands.com/Disclaimer-drawings for a full copy of the disclaimer.

Drawing: 4-24	Date: MAY/2024	Pg: 4
Title: HALO® EXTERRA® ABOVE GRADE WALL ASSEMBLY & HALO® SUBTERRA® OR SUBTERRA® PLUS BELOW GRADE ASSEMBLY		

EAVE PROTECTION SHALL BE PROVIDED ON SHINGLE, SHAKE OR TILE ROOFS, EXTENDING FROM THE EDGE OF THE ROOF A MINIMUM OF 36" (900MM) UP TO THE ROOF SLOPE TO A LINE NOT LESS THAN 12" (300MM) INSIDE THE INNER FACE OF THE EXTERIOR WALL (NBC 9.26.5.1.)

**BEST PRACTICE:** DRIP EDGE AT EAVE OF ROOF

**ROOF VENTING REQUIREMENTS**

- UNOBSTRUCTED VENT AREA SHALL NOT BE LESS THAN  $\frac{1}{100}$  OF THE INSULATED CEILING AREA OR WHERE ROOF SLOPE IS LESS THAN 1 IN 6 OR IN ROOFS THAT ARE CONSTRUCTED WITH ROOF JOISTS, THE UNOBSTRUCTED VENT AREA SHALL BE NOT LESS THAN  $\frac{1}{150}$  OF THE INSULATED CEILING AREA (NBC 9.19.1.1.)
- REQUIRED VENTS MAY BE ROOF TYPE, EAVE TYPE, GABLE-END TYPE OF ANY COMBINATION THEREOF, & SHALL BE DISTRIBUTED: UNIFORMLY ON OPPOSITE SIDES OF THE BUILDING, WITH NOT LESS THAN 25% OF THE REQUIRED OPENINGS LOCATED AT THE TOP OF THE SPACE, & WITH NOT LESS THAN 25% OF THE REQUIRED OPENINGS LOCATED AT THE BOTTOM OF THE SPACE (NBC 9.19.1.2.)

WHERE WALLS REQUIRED TO PROVIDE PROTECTION FROM PRECIPITATION COMPRISE CLADDING ASSEMBLIES WITH FIRST & SECOND PLANES OF PROTECTION,

- THE FIRST PLANE OF PROTECTION (CLADDING) SHALL CONSIST OF CLADDING WITH APPROPRIATE TRIM, ACCESSORY PIECES & FASTENERS
- THE SECOND PLANE OF PROTECTION (MECHANICALLY FASTENED, SELF-ADHERED, OR LIQUID APPLIED MEMBRANE (VAPOR PERMEABLE) APPLIED ON TOP OF EXTERIOR SHEATHING) SHALL BE DESIGNED & CONSTRUCTED TO:
  - INTERCEPT ALL RAIN & SNOW THAT GETS PAST THE FIRST PLANE OF PROTECTION, & EFFECTIVELY DISSIPATE ANY RAIN OR SNOW TO THE EXTERIOR, & THE PROTECTION PROVIDED BY THE FIRST & SECOND PLANES PROTECTION SHALL BE MAINTAINED
  - AT WALL PENETRATIONS CREATED BY THE INSTALLATION OF COMPONENTS AND SERVICES SUCH AS WINDOWS, DOORS, VENTILATION DUCTS, PIPING, WIRING & ELECTRICAL OUTLETS (NBC 9.27.2.3.)

AT LEAST ONE LAYER OF SHEATHING MEMBRANE SHALL BE APPLIED BENEATH CLADDING (NBC 9.27.3.3.)

CLADDING SHALL BE FASTENED TO THE FRAMING MEMBERS OR FURRING MEMBERS, OR TO BLOCKING BETWEEN FRAMING MEMBERS (NBC 9.27.5.1.)

REQUIREMENTS FOR LOW TO MODERATE WIND & SEISMIC FORCES, BRACING TO RESIST LATERAL LOADS SHALL BE DESIGNED & CONSTRUCTED AS FOLLOWS: i) CLAD WITH PANEL-TYPE CLADDING IN ACCORDANCE WITH NBC SECTION 9.27., ii) SHEATHING WITH PLYWOOD, OSB, WAFERBOARD, FIBREBOARD, GYPSUM BOARD OR DIAGONAL LUMBER SHEATHING, iii) FINISHED ON THE INTERIOR WITH A PANEL-TYPE MATERIAL IN ACCORDANCE WITH THE REQUIREMENTS OF NBC SECTION 9.29. OR IN ACCORDANCE WITH NBC ARTICLES 9.23.13.4. TO 9.23.13.7., PART 4, GOOD ENGINEERING PRACTICE SUCH AS THAT PROVIDED IN CWC 2014, "ENGINEERING GUIDE FOR WOOD FRAME CONSTRUCTION" (NBC 9.23.13.1.)

**BEST PRACTICE:** BUG SCREEN TOP & BOTTOM OF VENTILATED AIR SPACE

EXTERIOR FOUNDATION WALLS SHALL EXTEND NOT LESS THAN 6" (150MM) ABOVE FINISHED GROUND LEVEL (NBC 9.15.4.6.)

INSULATION ABOVE GRADE CANNOT BE LEFT EXPOSED COVER WITH GYPSUM OR CONCRETE BOARD & ACRYLIC PARGING (NBC 9.25.2.3. 6) 7)


WHERE THE EXTERIOR FINISHED GROUND LEVEL IS AT A HIGHER ELEVATION THAN THE GROUND LEVEL INSIDE THE FOUNDATION WALLS, EXTERIOR SURFACES OF FOUNDATION WALLS BELOW GROUND LEVEL SHALL BE DAMPPROOFED (NBC 9.13.2.1.)

DRAINAGE LAYER SHALL BE INSTALLED: MINERAL FIBRE INSULATION OR GRANULAR MATERIAL OR A SYSTEM THAT PROVIDES EQUIVALENT PERFORMANCE (NBC 9.14.2.1.)

**BEST PRACTICE:** COVER GRANULAR FILL WITH FABRIC CLOTH

MIN. 4" (100MM) DIAM. DRAIN TILE OR PIPE (NBC 9.14.3.2.) COVERED WITH NOT LESS THAN 6" (150MM) CRUSHED STONE OR OTHER COARSE CLEAN GRANULAR MATERIAL CONTAINING NOT MORE THAN 10% OF MATERIAL THAT WILL PASS A  $\frac{1}{8}$ " (4MM) SIEVE (NBC 9.14.3.3.4.)

**BEST PRACTICE:** FOOTING BARRIER MEMBRANE AS CAPILLARY BREAK BETWEEN FOOTING & FOUNDATION WALL

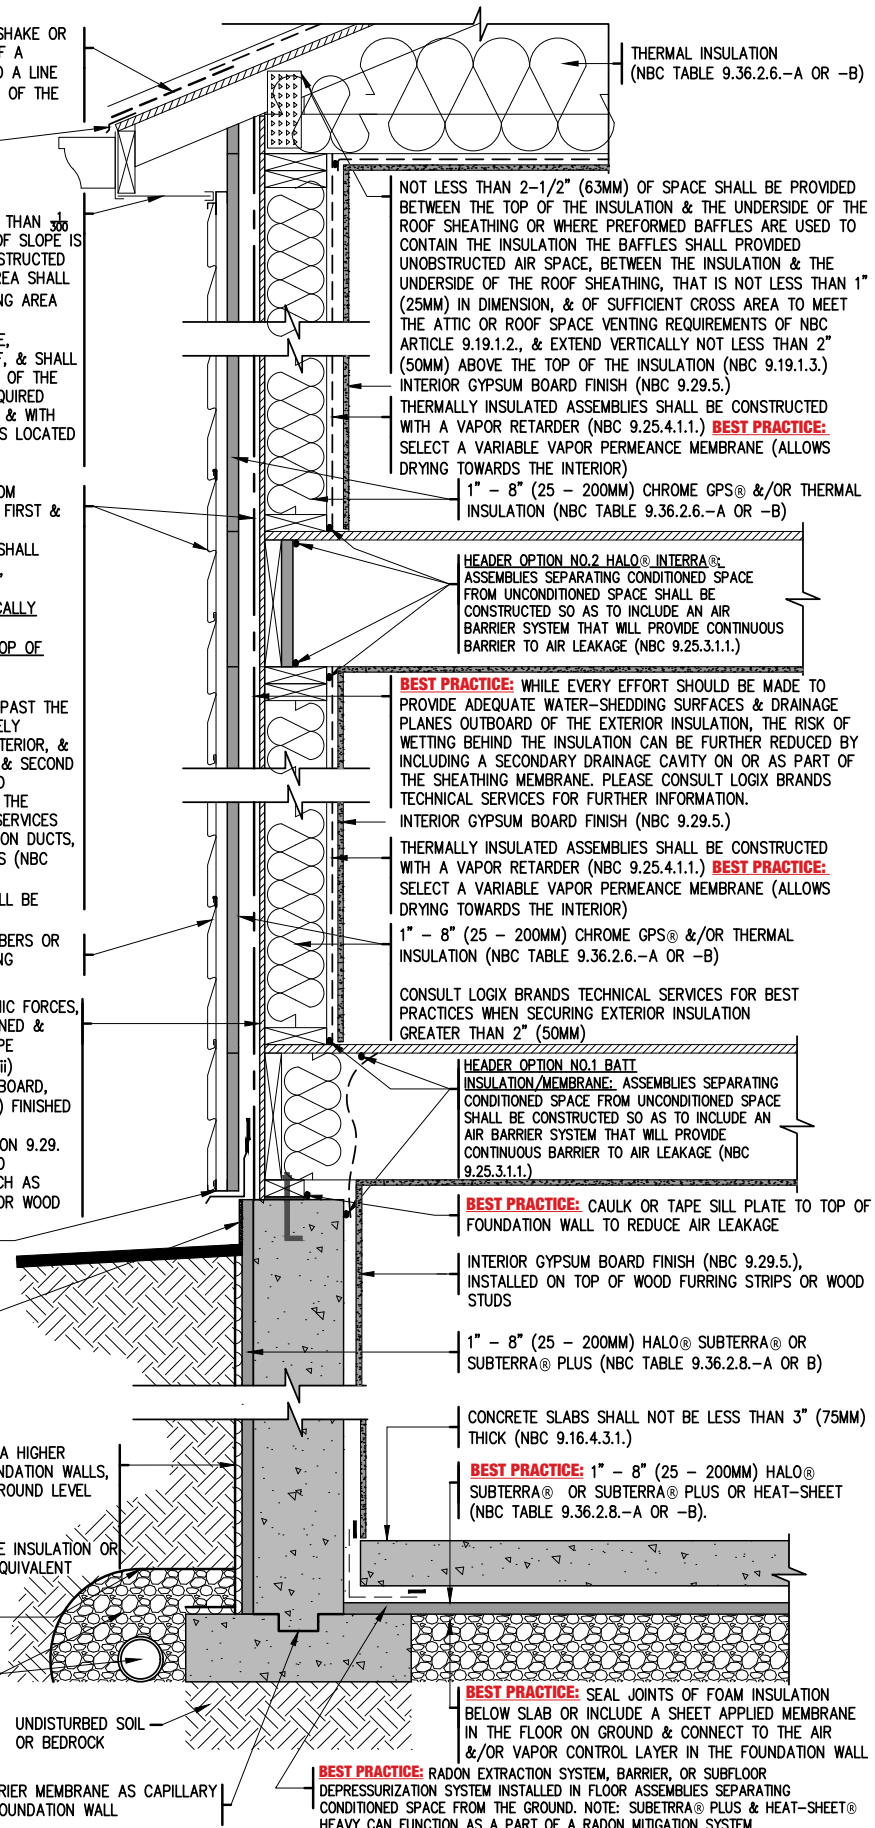

THERMAL INSULATION (NBC TABLE 9.36.2.6.-A OR -B)

NOT LESS THAN 2-1/2" (63MM) OF SPACE SHALL BE PROVIDED BETWEEN THE TOP OF THE INSULATION & THE UNDERSIDE OF THE ROOF SHEATHING OR WHERE PREFORMED BAFFLES ARE USED TO CONTAIN THE INSULATION THE BAFFLES SHALL PROVIDED UNOBSTRUCTED AIR SPACE, BETWEEN THE INSULATION & THE UNDERSIDE OF THE ROOF SHEATHING, THAT IS NOT LESS THAN 1" (25MM) IN DIMENSION, & OF SUFFICIENT CROSS AREA TO MEET THE ATTIC OR ROOF SPACE VENTING REQUIREMENTS OF NBC ARTICLE 9.19.1.2., & EXTEND VERTICALLY NOT LESS THAN 2" (50MM) ABOVE THE TOP OF THE INSULATION (NBC 9.19.1.3.)

INTERIOR GYPSUM BOARD FINISH (NBC 9.29.5.)

THERMALLY INSULATED ASSEMBLIES SHALL BE CONSTRUCTED WITH A VAPOR RETARDER (NBC 9.25.4.1.1.) **BEST PRACTICE:** SELECT A VARIABLE VAPOR PERMEANCE MEMBRANE (ALLOWS DRYING TOWARDS THE INTERIOR)

1" - 8" (25 - 200MM) CHROME GPS® &/OR THERMAL INSULATION (NBC TABLE 9.36.2.6.-A OR -B)

HEADER OPTION NO.2 HALO® INTERRA® ASSEMBLIES SEPARATING CONDITIONED SPACE FROM UNCONDITIONED SPACE SHALL BE CONSTRUCTED SO AS TO INCLUDE AN AIR BARRIER SYSTEM THAT WILL PROVIDE CONTINUOUS BARRIER TO AIR LEAKAGE (NBC 9.25.3.1.1.)

**BEST PRACTICE:** WHILE EVERY EFFORT SHOULD BE MADE TO PROVIDE ADEQUATE WATER-SHEDDING SURFACES & DRAINAGE PLANES OUTBOARD OF THE EXTERIOR INSULATION, THE RISK OF WETTING BEHIND THE INSULATION CAN BE FURTHER REDUCED BY INCLUDING A SECONDARY DRAINAGE CAVITY ON OR AS PART OF THE SHEATHING MEMBRANE. PLEASE CONSULT LOGIX BRANDS TECHNICAL SERVICES FOR FURTHER INFORMATION.

INTERIOR GYPSUM BOARD FINISH (NBC 9.29.5.)

THERMALLY INSULATED ASSEMBLIES SHALL BE CONSTRUCTED WITH A VAPOR RETARDER (NBC 9.25.4.1.1.) **BEST PRACTICE:** SELECT A VARIABLE VAPOR PERMEANCE MEMBRANE (ALLOWS DRYING TOWARDS THE INTERIOR)

1" - 8" (25 - 200MM) CHROME GPS® &/OR THERMAL INSULATION (NBC TABLE 9.36.2.6.-A OR -B)

CONSULT LOGIX BRANDS TECHNICAL SERVICES FOR BEST PRACTICES WHEN SECURING EXTERIOR INSULATION GREATER THAN 2" (50MM)

HEADER OPTION NO.1 BAIT INSULATION/MEMBRANE: ASSEMBLIES SEPARATING CONDITIONED SPACE FROM UNCONDITIONED SPACE SHALL BE CONSTRUCTED SO AS TO INCLUDE AN AIR BARRIER SYSTEM THAT WILL PROVIDE CONTINUOUS BARRIER TO AIR LEAKAGE (NBC 9.25.3.1.1.)

**BEST PRACTICE:** CAULK OR TAPE SILL PLATE TO TOP OF FOUNDATION WALL TO REDUCE AIR LEAKAGE

INTERIOR GYPSUM BOARD FINISH (NBC 9.29.5.), INSTALLED ON TOP OF WOOD FURRING STRIPS OR WOOD STUDS

1" - 8" (25 - 200MM) HALO® SUBTERRA® OR SUBTERRA® PLUS (NBC TABLE 9.36.2.8.-A OR B)

CONCRETE SLABS SHALL NOT BE LESS THAN 3" (75MM) THICK (NBC 9.16.4.3.1.)

**BEST PRACTICE:** 1" - 8" (25 - 200MM) HALO® SUBTERRA® OR SUBTERRA® PLUS OR HEAT-SHEET (NBC TABLE 9.36.2.8.-A OR -B).

**BEST PRACTICE:** SEAL JOINTS OF FOAM INSULATION BELOW SLAB OR INCLUDE A SHEET APPLIED MEMBRANE IN THE FLOOR ON GROUND & CONNECT TO THE AIR &/OR VAPOR CONTROL LAYER IN THE FOUNDATION WALL

**BEST PRACTICE:** RADON EXTRACTION SYSTEM, BARRIER, OR SUBFLOOR DEPRESSURIZATION SYSTEM INSTALLED IN FLOOR ASSEMBLIES SEPARATING CONDITIONED SPACE FROM THE GROUND. NOTE: SUBTERRA® PLUS & HEAT-SHEET® HEAVY CAN FUNCTION AS A PART OF A RADON MITIGATION SYSTEM

EAVE PROTECTION SHALL BE PROVIDED ON SHINGLE, SHAKE OR TILE ROOFS, EXTENDING FROM THE EDGE OF THE ROOF A MINIMUM OF 36" (900MM) UP TO THE ROOF SLOPE TO A LINE NOT LESS THAN 12" (300MM) INSIDE THE INNER FACE OF THE EXTERIOR WALL (NBC 9.26.5.1.)

**BEST PRACTICE:** DRIP EDGE AT EAVE OF ROOF

**ROOF VENTING REQUIREMENTS**

- UNOBSTRUCTED VENT AREA SHALL NOT BE LESS THAN  $\frac{1}{60}$  OF THE INSULATED CEILING AREA OR WHERE ROOF SLOPE IS LESS THAN 1 IN 6 OR IN ROOFS THAT ARE CONSTRUCTED WITH ROOF JOISTS, THE UNOBSTRUCTED VENT AREA SHALL BE NOT LESS THAN  $\frac{1}{150}$  OF THE INSULATED CEILING AREA (NBC 9.19.1.1.)
- REQUIRED VENTS MAY BE ROOF TYPE, EAVE TYPE, GABLE-END TYPE OF ANY COMBINATION THEREOF, & SHALL BE DISTRIBUTED: UNIFORMLY ON OPPOSITE SIDES OF THE BUILDING, WITH NOT LESS THAN 25% OF THE REQUIRED OPENINGS LOCATED AT THE TOP OF THE SPACE, & WITH NOT LESS THAN 25% OF THE REQUIRED OPENINGS LOCATED AT THE BOTTOM OF THE SPACE (NBC 9.19.1.2.)

WHERE WALLS REQUIRED TO PROVIDE PROTECTION FROM PRECIPITATION COMPRISE CLADDING ASSEMBLIES WITH FIRST & SECOND PLANES OF PROTECTION,

- THE FIRST PLANE OF PROTECTION (CLADDING) SHALL CONSIST OF CLADDING WITH APPROPRIATE TRIM, ACCESSORY PIECES & FASTENERS
- THE SECOND PLANE OF PROTECTION (HALO® EXTERRA® WITH TAPED OR CAULKED JOINTS & FASTENER PENETRATIONS. ALTERNATIVE DETAIL, MEMBRANE INSTALLED ON TOP OR BEHIND RIGID INSULATION) SHALL BE DESIGNED & CONSTRUCTED TO:
  - INTERCEPT ALL RAIN & SNOW THAT GETS PAST THE FIRST PLANE OF PROTECTION, & EFFECTIVELY DISSIPATE ANY RAIN OR SNOW TO THE EXTERIOR, & THE PROTECTION PROVIDED BY THE FIRST & SECOND PLANES PROTECTION SHALL BE MAINTAINED
  - AT WALL PENETRATIONS CREATED BY THE INSTALLATION OF COMPONENTS AND SERVICES SUCH AS WINDOWS, DOORS, VENTILATION DUCTS, PIPING, WIRING & ELECTRICAL OUTLETS (NBC 9.27.2.3.)

AT LEAST ONE LAYER OF SHEATHING MEMBRANE SHALL BE APPLIED BENEATH CLADDING (NBC 9.27.3.3.), WHERE NON-WOOD-BASED RIGID EXTERIOR INSULATING SHEATHING, OR EXTERIOR INSULATING SHEATHING WITH AN INTEGRAL SHEATHING MEMBRANE IS INSTALLED, A SEPARATE SHEATHING MEMBRANE IS NOT REQUIRED (NBC 9.27.3.4.)

CLADDING SHALL BE FASTENED TO THE FRAMING MEMBERS OR FURRING MEMBERS, OR TO BLOCKING BETWEEN FRAMING MEMBERS (NBC 9.27.5.1.)

REQUIREMENTS FOR LOW TO MODERATE WIND & SEISMIC FORCES, BRACING TO RESIST LATERAL LOADS SHALL BE DESIGNED & CONSTRUCTED AS FOLLOWS: i) CLAD WITH PANEL-TYPE CLADDING IN ACCORDANCE WITH NBC SECTION 9.27., ii) SHEATHING WITH PLYWOOD, OSB, WAFERBOARD, FIBREBOARD, GYPSUM BOARD OR DIAGONAL LUMBER SHEATHING, iii) FINISHED ON THE INTERIOR WITH A PANEL-TYPE MATERIAL IN ACCORDANCE WITH THE REQUIREMENTS OF NBC SECTION 9.29. OR IN ACCORDANCE WITH NBC ARTICLES 9.23.13.4. TO 9.23.13.7., PART 4, GOOD ENGINEERING PRACTICE SUCH AS THAT PROVIDED IN CWC 2014, "ENGINEERING GUIDE FOR WOOD FRAME CONSTRUCTION" (NBC 9.23.13.1.)

**BEST PRACTICE:** BUG SCREEN TOP & BOTTOM OF VENTILATED AIR SPACE


EXTERIOR FOUNDATION WALLS SHALL EXTEND NOT LESS THAN 6" (150MM) ABOVE FINISHED GROUND LEVEL (NBC 9.15.4.6.)

WHERE THE EXTERIOR FINISHED GROUND LEVEL IS AT A HIGHER ELEVATION THAN THE GROUND LEVEL INSIDE THE FOUNDATION WALLS, EXTERIOR SURFACES OF FOUNDATION WALLS BELOW GROUND LEVEL SHALL BE DAMPPROOFED (NBC 9.13.2.1.)

DRAINAGE LAYER SHALL BE INSTALLED: MINERAL FIBRE INSULATION OR GRANULAR MATERIAL OR A SYSTEM THAT PROVIDES EQUIVALENT PERFORMANCE (NBC 9.14.2.1.)

**BEST PRACTICE:** COVER GRANULAR FILL WITH FABRIC CLOTH MIN. 4" (100MM) DIAM. DRAIN TILE OR PIPE (NBC 9.14.3.2.) COVERED WITH NOT LESS THAN 6" (150MM) CRUSHED STONE OR OTHER COARSE CLEAN GRANULAR MATERIAL CONTAINING NOT MORE THAN 10% OF MATERIAL THAT WILL PASS A  $\frac{3}{8}$ " (4MM) SIEVE (NBC 9.14.3.3.4.)

**BEST PRACTICE:** FOOTING BARRIER MEMBRANE AS CAPILLARY BREAK BETWEEN FOOTING & FOUNDATION WALL

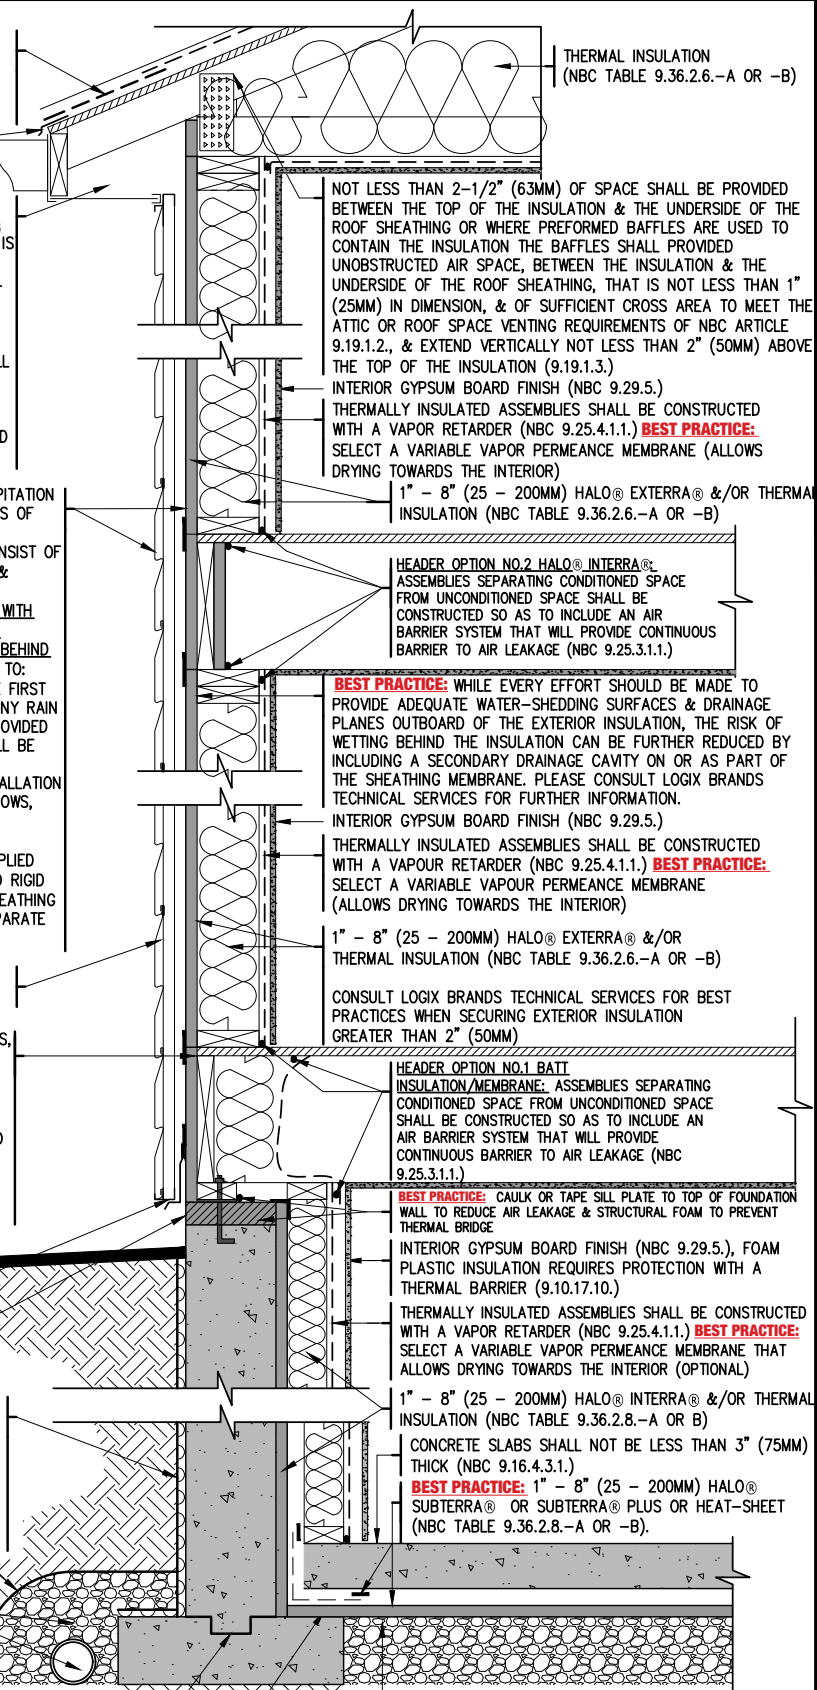

NOT LESS THAN 2-1/2" (63MM) OF SPACE SHALL BE PROVIDED BETWEEN THE TOP OF THE INSULATION & THE UNDERSIDE OF THE ROOF SHEATHING OR WHERE PREFORMED BAFFLES ARE USED TO CONTAIN THE INSULATION THE BAFFLES SHALL PROVIDED UNOBSTRUCTED AIR SPACE, BETWEEN THE INSULATION & THE UNDERSIDE OF THE ROOF SHEATHING, THAT IS NOT LESS THAN 1" (25MM) IN DIMENSION, & OF SUFFICIENT CROSS AREA TO MEET THE ATTIC OR ROOF SPACE VENTING REQUIREMENTS OF NBC ARTICLE 9.19.1.2., & EXTEND VERTICALLY NOT LESS THAN 2" (50MM) ABOVE THE TOP OF THE INSULATION (9.19.1.3.)

INTERIOR GYPSUM BOARD FINISH (NBC 9.29.5.)  
THERMALLY INSULATED ASSEMBLIES SHALL BE CONSTRUCTED WITH A VAPOR RETARDER (NBC 9.25.4.1.1.) **BEST PRACTICE:** SELECT A VARIABLE VAPOR PERMEANCE MEMBRANE (ALLOWS DRYING TOWARDS THE INTERIOR)

1" - 8" (25 - 200MM) HALO® EXTERRA® &/OR THERMAL INSULATION (NBC TABLE 9.36.2.6.-A OR -B)

HEADER OPTION NO.2 HALO® INTERRA® ASSEMBLIES SEPARATING CONDITIONED SPACE FROM UNCONDITIONED SPACE SHALL BE CONSTRUCTED SO AS TO INCLUDE AN AIR BARRIER SYSTEM THAT WILL PROVIDE CONTINUOUS BARRIER TO AIR LEAKAGE (NBC 9.25.3.1.1.)

**BEST PRACTICE:** WHILE EVERY EFFORT SHOULD BE MADE TO PROVIDE ADEQUATE WATER-SHEDDING SURFACES & DRAINAGE PLANES OUTBOARD OF THE EXTERIOR INSULATION, THE RISK OF WETTING BEHIND THE INSULATION CAN BE FURTHER REDUCED BY INCLUDING A SECONDARY DRAINAGE CAVITY ON OR AS PART OF THE SHEATHING MEMBRANE. PLEASE CONSULT LOGIX BRANDS TECHNICAL SERVICES FOR FURTHER INFORMATION.

INTERIOR GYPSUM BOARD FINISH (NBC 9.29.5.)  
THERMALLY INSULATED ASSEMBLIES SHALL BE CONSTRUCTED WITH A VAPOUR RETARDER (NBC 9.25.4.1.1.) **BEST PRACTICE:** SELECT A VARIABLE VAPOUR PERMEANCE MEMBRANE (ALLOWS DRYING TOWARDS THE INTERIOR)

1" - 8" (25 - 200MM) HALO® EXTERRA® &/OR THERMAL INSULATION (NBC TABLE 9.36.2.6.-A OR -B)

CONSULT LOGIX BRANDS TECHNICAL SERVICES FOR BEST PRACTICES WHEN SECURING EXTERIOR INSULATION GREATER THAN 2" (50MM)

HEADER OPTION NO.1 BATT INSULATION/MEMBRANE: ASSEMBLIES SEPARATING CONDITIONED SPACE FROM UNCONDITIONED SPACE SHALL BE CONSTRUCTED SO AS TO INCLUDE AN AIR BARRIER SYSTEM THAT WILL PROVIDE CONTINUOUS BARRIER TO AIR LEAKAGE (NBC 9.25.3.1.1.)

**BEST PRACTICE:** CAULK OR TAPE SILL PLATE TO TOP OF FOUNDATION WALL TO REDUCE AIR LEAKAGE & STRUCTURAL FOAM TO PREVENT THERMAL BRIDGE

INTERIOR GYPSUM BOARD FINISH (NBC 9.29.5.), FOAM PLASTIC INSULATION REQUIRES PROTECTION WITH A THERMAL BARRIER (9.10.17.10.)

THERMALLY INSULATED ASSEMBLIES SHALL BE CONSTRUCTED WITH A VAPOR RETARDER (NBC 9.25.4.1.1.) **BEST PRACTICE:** SELECT A VARIABLE VAPOR PERMEANCE MEMBRANE THAT ALLOWS DRYING TOWARDS THE INTERIOR (OPTIONAL)

1" - 8" (25 - 200MM) HALO® INTERRA® &/OR THERMAL INSULATION (NBC TABLE 9.36.2.8.-A OR B)

CONCRETE SLABS SHALL NOT BE LESS THAN 3" (75MM) THICK (NBC 9.16.4.3.1.)

**BEST PRACTICE:** 1" - 8" (25 - 200MM) HALO® SUBTERRA® OR SUBTERRA® PLUS OR HEAT-SHEET (NBC TABLE 9.36.2.8.-A OR -B).

**BEST PRACTICE:** SEAL JOINTS OF FOAM INSULATION BELOW SLAB OR INCLUDE A SHEET APPLIED MEMBRANE IN THE FLOOR ON GROUND & CONNECT TO THE AIR &/OR VAPOR CONTROL LAYER IN THE FOUNDATION WALL

**BEST PRACTICE:** RADON EXTRACTION SYSTEM, BARRIER, OR SUBFLOOR DEPRESSURIZATION SYSTEM INSTALLED IN WALL OR FLOOR ASSEMBLIES SEPARATING CONDITIONED SPACE FROM THE GROUND. NOTE: SUBTERRA® PLUS & HEAT-SHEET® HEAVY CAN FUNCTION AS A PART OF A RADON MITIGATION SYSTEM

EAVE PROTECTION SHALL BE PROVIDED ON SHINGLE, SHAKE OR TILE ROOFS, EXTENDING FROM THE EDGE OF THE ROOF A MINIMUM OF 36" (900MM) UP TO THE ROOF SLOPE TO A LINE NOT LESS THAN 12" (300MM) INSIDE THE INNER FACE OF THE EXTERIOR WALL (NBC 9.26.5.1.)

**BEST PRACTICE:** DRIP EDGE AT EAVE OF ROOF

**ROOF VENTING REQUIREMENTS**

- UNOBSTRUCTED VENT AREA SHALL NOT BE LESS THAN  $\frac{1}{60}$  OF THE INSULATED CEILING AREA OR WHERE ROOF SLOPE IS LESS THAN 1 IN 6 OR IN ROOFS THAT ARE CONSTRUCTED WITH ROOF JOISTS, THE UNOBSTRUCTED VENT AREA SHALL BE NOT LESS THAN  $\frac{1}{150}$  OF THE INSULATED CEILING AREA (9.19.1.1.)
- REQUIRED VENTS MAY BE ROOF TYPE, EAVE TYPE, GABLE-END TYPE OF ANY COMBINATION THEREOF, & SHALL BE DISTRIBUTED: UNIFORMLY ON OPPOSITE SIDES OF THE BUILDING, WITH NOT LESS THAN 25% OF THE REQUIRED OPENINGS LOCATED AT THE TOP OF THE SPACE, & WITH NOT LESS THAN 25% OF THE REQUIRED OPENINGS LOCATED AT THE BOTTOM OF THE SPACE (NBC 9.19.1.2.)

WHERE WALLS REQUIRED TO PROVIDE PROTECTION FROM PRECIPITATION COMPRISE CLADDING ASSEMBLIES WITH FIRST & SECOND PLANES OF PROTECTION,

- THE FIRST PLANE OF PROTECTION (**CLADDING**) SHALL CONSIST OF CLADDING WITH APPROPRIATE TRIM, ACCESSORY PIECES & FASTENERS
- THE SECOND PLANE OF PROTECTION (**MECHANICALLY FASTENED, SELF-ADHERED, OR LIQUID APPLIED MEMBRANE (VAPOR PERMEABLE)**) SHALL BE DESIGNED & CONSTRUCTED TO:
  - INTERCEPT ALL RAIN & SNOW THAT GETS PAST THE FIRST PLANE OF PROTECTION, & EFFECTIVELY DISSIPATE ANY RAIN OR SNOW TO THE EXTERIOR, & THE PROTECTION PROVIDED BY THE FIRST & SECOND PLANES PROTECTION SHALL BE MAINTAINED
  - AT WALL PENETRATIONS CREATED BY THE INSTALLATION OF COMPONENTS AND SERVICES SUCH AS WINDOWS, DOORS, VENTILATION DUCTS, PIPING, WIRING & ELECTRICAL OUTLETS (NBC 9.27.2.3.)

AT LEAST ONE LAYER OF SHEATHING MEMBRANE SHALL BE APPLIED BENEATH CLADDING (NBC 9.27.3.3.)  
CLADDING SHALL BE FASTENED TO THE FRAMING MEMBERS OR FURRING MEMBERS, OR TO BLOCKING BETWEEN FRAMING MEMBERS (NBC 9.27.5.1.)

REQUIREMENTS FOR LOW TO MODERATE WIND & SEISMIC FORCES, BRACING TO RESIST LATERAL LOADS SHALL BE DESIGNED & CONSTRUCTED AS FOLLOWS: i) CLAD WITH PANEL-TYPE CLADDING IN ACCORDANCE WITH NBC SECTION 9.27., ii) SHEATHING WITH PLYWOOD, OSB, WAFERBOARD, FIBREBOARD, GYPSUM BOARD OR DIAGONAL LUMBER SHEATHING, iii) FINISHED ON THE INTERIOR WITH A PANEL-TYPE MATERIAL IN ACCORDANCE WITH THE REQUIREMENTS OF NBC SECTION 9.29. OR IN ACCORDANCE WITH NBC ARTICLES 9.23.13.4. TO 9.23.13.7., PART 4, GOOD ENGINEERING PRACTICE SUCH AS THAT PROVIDED IN CWC 2014, "ENGINEERING GUIDE FOR WOOD FRAME CONSTRUCTION" (NBC 9.23.13.1.)

**BEST PRACTICE:** BUG SCREEN TOP & BOTTOM OF VENTILATED AIR SPACE


EXTERIOR FOUNDATION WALLS SHALL EXTEND NOT LESS THAN 6" (150MM) ABOVE FINISHED GROUND LEVEL (NBC 9.15.4.6.)

WHERE THE EXTERIOR FINISHED GROUND LEVEL IS AT A HIGHER ELEVATION THAN THE GROUND LEVEL INSIDE THE FOUNDATION WALLS, EXTERIOR SURFACES OF FOUNDATION WALLS BELOW GROUND LEVEL SHALL BE DAMPROOFED (NBC 9.13.2.1.)

DRAINAGE LAYER SHALL BE INSTALLED: MINERAL FIBRE INSULATION OR GRANULAR MATERIAL OR A SYSTEM THAT PROVIDES EQUIVALENT PERFORMANCE (NBC 9.14.2.1.)

**BEST PRACTICE:** COVER GRANULAR FILL WITH FABRIC CLOTH - MIN. 4" (100MM) DIAM. DRAIN TILE OR PIPE (NBC 9.14.3.2.) COVERED WITH NOT LESS THAN 6" (150MM) CRUSHED STONE OR OTHER COARSE CLEAN GRANULAR MATERIAL CONTAINING NOT MORE THAN 10% OF MATERIAL THAT WILL PASS A  $\frac{1}{8}$ " (4MM) SIEVE (NBC 9.14.3.3.4.)

**BEST PRACTICE:** FOOTING BARRIER MEMBRANE AS CAPILLARY BREAK BETWEEN FOOTING & FOUNDATION WALL

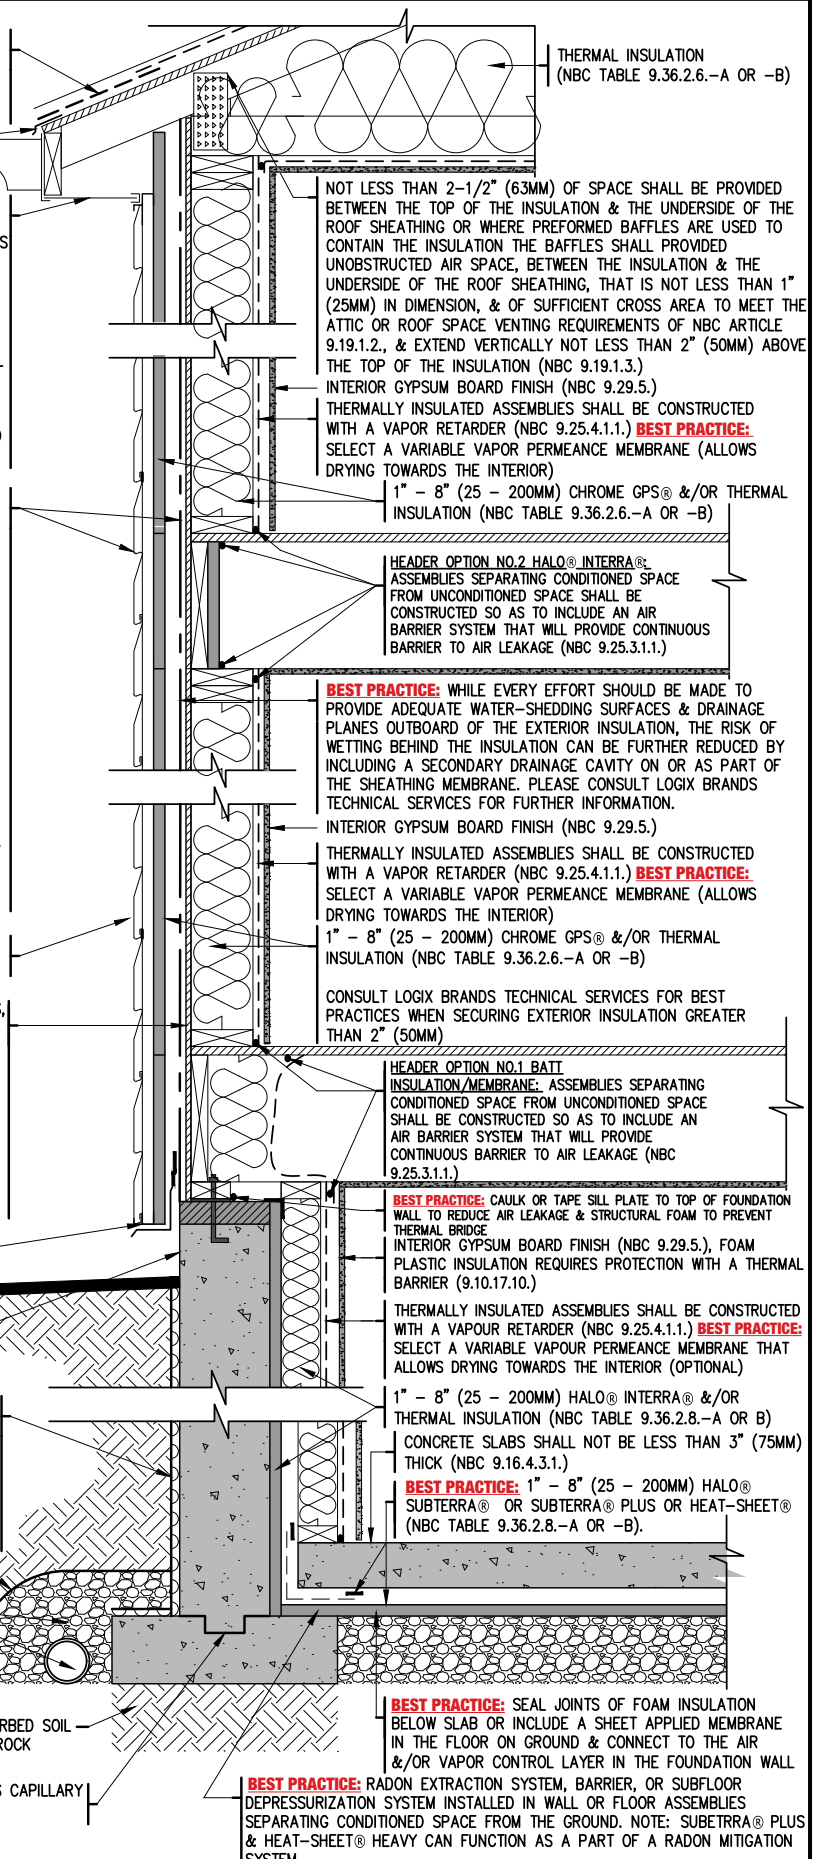

NOT LESS THAN 2-1/2" (63MM) OF SPACE SHALL BE PROVIDED BETWEEN THE TOP OF THE INSULATION & THE UNDERSIDE OF THE ROOF SHEATHING OR WHERE PREFORMED BAFFLES ARE USED TO CONTAIN THE INSULATION THE BAFFLES SHALL PROVIDED UNOBSTRUCTED AIR SPACE, BETWEEN THE INSULATION & THE UNDERSIDE OF THE ROOF SHEATHING, THAT IS NOT LESS THAN 1" (25MM) IN DIMENSION, & OF SUFFICIENT CROSS AREA TO MEET THE ATTIC OR ROOF SPACE VENTING REQUIREMENTS OF NBC ARTICLE 9.19.1.2., & EXTEND VERTICALLY NOT LESS THAN 2" (50MM) ABOVE THE TOP OF THE INSULATION (NBC 9.19.1.3.)

INTERIOR GYPSUM BOARD FINISH (NBC 9.29.5.)  
THERMALLY INSULATED ASSEMBLIES SHALL BE CONSTRUCTED WITH A VAPOR RETARDER (NBC 9.25.4.1.1.) **BEST PRACTICE:** SELECT A VARIABLE VAPOR PERMEANCE MEMBRANE (ALLOWS DRYING TOWARDS THE INTERIOR)

1" - 8" (25 - 200MM) CHROME GPS® &/OR THERMAL INSULATION (NBC TABLE 9.36.2.6.-A OR -B)

HEADER OPTION NO.2 HALO® INTERRA® ASSEMBLIES SEPARATING CONDITIONED SPACE FROM UNCONDITIONED SPACE SHALL BE CONSTRUCTED SO AS TO INCLUDE AN AIR BARRIER SYSTEM THAT WILL PROVIDE CONTINUOUS BARRIER TO AIR LEAKAGE (NBC 9.25.3.1.1.)

**BEST PRACTICE:** WHILE EVERY EFFORT SHOULD BE MADE TO PROVIDE ADEQUATE WATER-SHEDDING SURFACES & DRAINAGE PLANES OUTBOARD OF THE EXTERIOR INSULATION, THE RISK OF WETTING BEHIND THE INSULATION CAN BE FURTHER REDUCED BY INCLUDING A SECONDARY DRAINAGE CAVITY ON OR AS PART OF THE SHEATHING MEMBRANE. PLEASE CONSULT LOGIX BRANDS TECHNICAL SERVICES FOR FURTHER INFORMATION.

INTERIOR GYPSUM BOARD FINISH (NBC 9.29.5.)

THERMALLY INSULATED ASSEMBLIES SHALL BE CONSTRUCTED WITH A VAPOR RETARDER (NBC 9.25.4.1.1.) **BEST PRACTICE:** SELECT A VARIABLE VAPOR PERMEANCE MEMBRANE (ALLOWS DRYING TOWARDS THE INTERIOR)

1" - 8" (25 - 200MM) CHROME GPS® &/OR THERMAL INSULATION (NBC TABLE 9.36.2.6.-A OR -B)

CONSULT LOGIX BRANDS TECHNICAL SERVICES FOR BEST PRACTICES WHEN SECURING EXTERIOR INSULATION GREATER THAN 2" (50MM)

HEADER OPTION NO.1 BATT INSULATION/MEMBRANE: ASSEMBLIES SEPARATING CONDITIONED SPACE FROM UNCONDITIONED SPACE SHALL BE CONSTRUCTED SO AS TO INCLUDE AN AIR BARRIER SYSTEM THAT WILL PROVIDE CONTINUOUS BARRIER TO AIR LEAKAGE (NBC 9.25.3.1.1.)

**BEST PRACTICE:** CAULK OR TAPE SILL PLATE TO TOP OF FOUNDATION WALL TO REDUCE AIR LEAKAGE & STRUCTURAL FOAM TO PREVENT THERMAL BRIDGE

INTERIOR GYPSUM BOARD FINISH (NBC 9.29.5.), FOAM PLASTIC INSULATION REQUIRES PROTECTION WITH A THERMAL BARRIER (9.10.17.10.)

THERMALLY INSULATED ASSEMBLIES SHALL BE CONSTRUCTED WITH A VAPOUR RETARDER (NBC 9.25.4.1.1.) **BEST PRACTICE:** SELECT A VARIABLE VAPOUR PERMEANCE MEMBRANE THAT ALLOWS DRYING TOWARDS THE INTERIOR (OPTIONAL)

1" - 8" (25 - 200MM) HALO® INTERRA® &/OR THERMAL INSULATION (NBC TABLE 9.36.2.8.-A OR B)

CONCRETE SLABS SHALL NOT BE LESS THAN 3" (75MM) THICK (NBC 9.16.4.3.1.)

**BEST PRACTICE:** 1" - 8" (25 - 200MM) HALO® SUBTERRA® OR SUBTERRA® PLUS OR HEAT-SHEET® (NBC TABLE 9.36.2.8.-A OR -B).

**BEST PRACTICE:** SEAL JOINTS OF FOAM INSULATION BELOW SLAB OR INCLUDE A SHEET APPLIED MEMBRANE IN THE FLOOR ON GROUND & CONNECT TO THE AIR &/OR VAPOR CONTROL LAYER IN THE FOUNDATION WALL

**BEST PRACTICE:** RADON EXTRACTION SYSTEM, BARRIER, OR SUBFLOOR DEPRESSURIZATION SYSTEM INSTALLED IN WALL OR FLOOR ASSEMBLIES SEPARATING CONDITIONED SPACE FROM THE GROUND. NOTE: SUBETTRA® PLUS & HEAT-SHEET® HEAVY CAN FUNCTION AS A PART OF A RADON MITIGATION SYSTEM



© Copyright Logix Brands Ltd. (2024) All rights reserved. No part of the work contained herein as covered by this copyright may be reproduced or used in any form, or any means - graphic, electronic or mechanical, including without limitation photocopying. By using these drawings, you agree to assume all risks associated therewith. See [Logixbrands.com/Disclaimer-drawings](https://www.logixbrands.com/Disclaimer-drawings) for a full copy of the disclaimer.

Drawing: 7-24	Date: MAY/2024	Pg: 7
Title: CHROME GPS® ABOVE GRADE WALL ASSEMBLY & HALO® INTERRA® & HALO® SUBTERRA® OR SUBTERRA® PLUS BELOW GRADE ASSEMBLY		

WHERE WALLS REQUIRED TO PROVIDE PROTECTION FROM PRECIPITATION COMPRISE CLADDING ASSEMBLIES WITH FIRST & SECOND PLANES OF PROTECTION,

- THE FIRST PLANE OF PROTECTION (CLADDING) SHALL CONSIST OF CLADDING WITH APPROPRIATE TRIM, ACCESSORY PIECES & FASTENERS
- THE SECOND PLANE OF PROTECTION (HALO® EXTERRA® WITH TAPED OR CAULKED JOINTS & FASTENER PENETRATIONS. ALTERNATIVE DETAIL (MEMBRANE INSTALLED ON TOP OR BEHIND RIGID INSULATION))

**BEST PRACTICE:** BUG SCREEN TOP & BOTTOM OF VENTILATED AIR SPACE  
FLASHING TAPED OR CAULKED TO FRONT FACE OF FOAM INSULATION  
EXTERIOR FOUNDATION WALLS SHALL EXTEND NOT LESS THAN 6" (150MM) ABOVE FINISHED GROUND LEVEL (NBC 9.15.4.6.)

INSULATION ABOVE GRADE CANNOT BE LEFT EXPOSED COVER WITH GYPSUM OR CONCRETE BOARD & ACRYLIC PARGING (NBC 9.25.2.3. 6) 7)

**BEST PRACTICE:** COVER GRANULAR FILL WITH FABRIC CLOTH  
MIN. 4" (100MM) DIAM. DRAIN TILE OR PIPE (NBC 9.14.3.2.) COVERED WITH NOT LESS THAN 6" (150MM) CRUSHED STONE OR OTHER COARSE CLEAN GRANULAR MATERIAL CONTAINING NOT MORE THAN 10% OF MATERIAL THAT WILL PASS A 1/8" (4MM) SIEVE (NBC 9.14.3.3.4.)

UNDISTURBED SOIL OR BEDROCK

**BEST PRACTICE:** WHILE EVERY EFFORT SHOULD BE MADE TO PROVIDE ADEQUATE WATER-SHEDDING SURFACES & DRAINAGE PLANES OUTBOARD OF THE EXTERIOR INSULATION, THE RISK OF WETTING BEHIND THE INSULATION CAN BE FURTHER REDUCED BY INCLUDING A SECONDARY DRAINAGE CAVITY ON OR AS PART OF THE SHEATHING MEMBRANE. PLEASE CONSULT LOGIX BRANDS TECHNICAL SERVICES FOR FURTHER INFORMATION.

1" - 8" (25 - 200MM) HALO® EXTERRA® &/OR THERMAL INSULATION (NBC TABLE 9.36.2.6.-A OR -B)

CONSULT LOGIX BRANDS TECHNICAL SERVICES FOR BEST PRACTICES WHEN SECURING EXTERIOR INSULATION GREATER THAN 2" (50MM)

INTERIOR GYPSUM BOARD FINISH (NBC 9.29.5.)

THERMALLY INSULATED ASSEMBLIES SHALL BE CONSTRUCTED WITH A VAPOR RETARDER (NBC 9.25.4.1.1.) **BEST PRACTICE:** SELECT A VARIABLE VAPOR PERMEANCE MEMBRANE (ALLOWS DRYING TOWARDS THE INTERIOR)

ASSEMBLIES SEPARATING CONDITIONED SPACE FROM UNCONDITIONED SPACE SHALL BE CONSTRUCTED SO AS TO INCLUDE AN AIR BARRIER SYSTEM THAT WILL PROVIDE CONTINUOUS BARRIER TO AIR LEAKAGE (NBC 9.25.3.1.1.)

CONCRETE SLAB & REINFORCEMENT DESIGNED AS PER MIN. CODR OR ENGINEER

**BEST PRACTICE:** 1" - 8" (25 - 200MM) HALO® SUBTERRA® OR SUBTERRA® PLUS OR HEAT-SHEET (NBC TABLE 9.36.2.8.-A OR -B).

**BEST PRACTICE:** RADON EXTRACTION SYSTEM, BARRIER, OR SUBFLOOR DEPRESSURIZATION SYSTEM INSTALLED IN FLOOR ASSEMBLIES SEPARATING CONDITIONED SPACE FROM THE GROUND.  
NOTE: SUBTERRA® PLUS & HEAT-SHEET® HEAVY CAN FUNCTION AS A PART OF A RADON MITIGATION SYSTEM

**BEST PRACTICE:** SEAL JOINTS OF FOAM INSULATION BELOW SLAB (AIR BARRIER) OR INCLUDE A SHEET APPLIED MEMBRANE IN THE FLOOR ON GROUND & CONNECT TO THE AIR AND/OR VAPOR CONTROL LAYER IN THE ABOVE GRADE WALL

**BEST PRACTICE:** FOOTING BARRIER MEMBRANE AS CAPILLARY BREAK BETWEEN SLAB & ABOVE GRADE WALL

#### 4 BUILDING SCIENCE CONTROL LAYERS

- WATER: FRONT FACE HALO® EXTERRA®
  - NOTE: ALTERNATIVE DETAIL; MECHANICALLY FASTENED, PEEL & STICK, OR LIQUID APPLIED MEMBRANE APPLIED TO FRONT FACE OR INBEHIND HALO® EXTERRA®
- AIR: INTERIOR MEMBRANE CONNECTED TO CONCRETE FLOOR
  - NOTE: BEST PRACTICE APPLY SHEET APPLIED MEMBRANE IN FLOOR SLAB & CONNECT TO INTERIOR WALL MEMBRANE
- THERMAL: HALO® SUBTERRA® OR SUBTERRA® PLUS OR HEAT-SHEET® BELOW SLAB & HALO® EXTERRA® & INSULATION BETWEEN STUDS
- VAPOR: INSULATION BELOW SLAB & INTERIOR MEMBRANE ABOVE GRADE WALL
  - NOTE: BEST PRACTICE SELECT VARIABLE VAPOR PERMEABLE MEMBRANE FOR ABOVE GRADE WALL ASSEMBLY (ALLOWS DRYING TOWARDS INTERIOR)

WHERE WALLS REQUIRED TO PROVIDE PROTECTION FROM PRECIPITATION COMPRISE CLADDING ASSEMBLIES WITH FIRST & SECOND PLANES OF PROTECTION,

- THE FIRST PLANE OF PROTECTION (CLADDING) SHALL CONSIST OF CLADDING WITH APPROPRIATE TRIM, ACCESSORY PIECES & FASTENERS
- THE SECOND PLANE OF PROTECTION (MECHANICALLY FASTENED, SELF-ADHERED, OR LIQUID APPLIED MEMBRANE (VAPOUR PERMEABLE), BEHIND OR IN FRONT OF RIGID INSULATION)

**BEST PRACTICE:** BUG SCREEN TOP & BOTTOM OF VENTILATED AIR SPACE

FLASHING TAPED OR CAULKED TO FRONT FACE OF MEMBRANE

EXTERIOR FOUNDATION WALLS SHALL EXTEND NOT LESS THAN 6" (150MM) ABOVE FINISHED GROUND LEVEL (NBC 9.15.4.6.)

INSULATION ABOVE GRADE CANNOT BE LEFT EXPOSED COVER WITH GYPSUM OR CONCRETE BOARD & ACRYLIC PARGING (NBC 9.25.2.3. 6) 7)

**BEST PRACTICE:** COVER GRANULAR FILL WITH FABRIC CLOTH  
MIN. 4" (100MM) DIAM. DRAIN TILE OR PIPE (NBC 9.14.3.2.) COVERED WITH NOT LESS THAN 6" (150MM) CRUSHED STONE OR OTHER COARSE CLEAN GRANULAR MATERIAL CONTAINING NOT MORE THAN 10% OF MATERIAL THAT WILL PASS A 1/8" (4MM) SIEVE (NBC 9.14.3.3.4.)

UNDISTURBED SOIL OR BEDROCK

**BEST PRACTICE:** WHILE EVERY EFFORT SHOULD BE MADE TO PROVIDE ADEQUATE WATER-SHEDDING SURFACES & DRAINAGE PLANES OUTBOARD OF THE EXTERIOR INSULATION, THE RISK OF WETTING BEHIND THE INSULATION CAN BE FURTHER REDUCED BY INCLUDING A SECONDARY DRAINAGE CAVITY ON OR AS PART OF THE SHEATHING MEMBRANE. PLEASE CONSULT LOGIX BRANDS TECHNICAL SERVICES FOR FURTHER INFORMATION.

1" - 8" (25 - 200MM) CHROME GPS® &/OR THERMAL INSULATION (NBC TABLE 9.36.2.6.-A OR -B)

CONSULT LOGIX BRANDS TECHNICAL SERVICES FOR BEST PRACTICES WHEN SECURING EXTERIOR INSULATION GREATER THAN 2" (50MM)

INTERIOR GYPSUM BOARD FINISH (NBC 9.29.5.)

THERMALLY INSULATED ASSEMBLIES SHALL BE CONSTRUCTED WITH A VAPOR RETARDER (NBC 9.25.4.1.1.) **BEST PRACTICE:** SELECT A VARIABLE VAPOR PERMEANCE MEMBRANE (ALLOWS DRYING TOWARDS THE INTERIOR)

ASSEMBLIES SEPARATING CONDITIONED SPACE FROM UNCONDITIONED SPACE SHALL BE CONSTRUCTED SO AS TO INCLUDE AN AIR BARRIER SYSTEM THAT WILL PROVIDE CONTINUOUS BARRIER TO AIR LEAKAGE (NBC 9.25.3.1.1.)

CONCRETE SLAB & REINFORCEMENT DESIGNED AS PER MIN. CODE OR ENGINEER

**BEST PRACTICE:** 1" - 8" (25 - 200MM) HALO® SUBTERRA® OR SUBTERRA® PLUS OR HEAT-SHEET® (NBC TABLE 9.36.2.8.-A OR -B).

**BEST PRACTICE:** RADON EXTRACTION SYSTEM, BARRIER, OR SUBFLOOR DEPRESSURIZATION SYSTEM INSTALLED IN FLOOR ASSEMBLIES SEPARATING CONDITIONED SPACE FROM THE GROUND. NOTE: SUBTERRA® PLUS & HEAT-SHEET® HEAVY CAN FUNCTION AS A PART OF A RADON MITIGATION SYSTEM

**BEST PRACTICE:** SEAL JOINTS OF FOAM INSULATION BELOW SLAB (AIR BARRIER) OR INCLUDE A SHEET APPLIED MEMBRANE IN THE FLOOR ON GROUND & CONNECT TO THE AIR AND/OR VAPOR CONTROL LAYER IN THE ABOVE GRADE WALL

**BEST PRACTICE:** FOOTING BARRIER MEMBRANE AS CAPILLARY BREAK BETWEEN SLAB & ABOVE GRADE WALL

#### 4 BUILDING SCIENCE CONTROL LAYERS

- WATER: MECHANICALLY FASTENED, PEEL & STICK, OR LIQUID APPLIED MEMBRANE ON TOP OF EXTERIOR SHEATHING
  - NOTE: MEMBRANE COULD FUNCTION AS AIR CONTROL LAYER & INTERIOR MEMBRANE AS THE AIR CONTROL LAYER COULD BE OMITTED (STILL REQUIRED VAPOR CONTROL LAYER ON WARM SIDE OF ASSEMBLY)
- AIR: INTERIOR MEMBRANE CONNECTED TO CONCRETE FLOOR
  - NOTE: BEST PRACTICE APPLY SHEET APPLIED MEMBRANE IN FLOOR SLAB & CONNECT TO INTERIOR WALL MEMBRANE
- THERMAL: HALO® SUBTERRA® OR SUBTERRA® PLUS OR HEAT-SHEET® BELOW SLAB & CHROME GPS® & INSULATION BETWEEN STUDS
- VAPOR: INSULATION BELOW SLAB & INTERIOR BELOW GRADE WALL MEMBRANE OR IF INTERIOR MEMBRANE OMITTED WHEN AIR CONTROL LAYER IS PLACED ON THE EXTERIOR OF THE BUILDING ENCLOSURE A VAPOR RETARDING PAINT CAN BE APPLIED TO THE GYPSUM BOARD
  - NOTE: BEST PRACTICE SELECT VARIABLE VAPOR PERMEABLE MEMBRANE FOR ABOVE GRADE WALL ASSEMBLY (ALLOWS TOWARDS INTERIOR)

© Copyright Logix Brands Ltd. (2024) All rights reserved. No part of the work contained herein as covered by this copyright may be reproduced or used in any form, or any means - graphic, electronic or mechanical, including without limitation photocopying. By using these drawings, you agree to assume all risks associated therewith. See [Logixbrands.com/Disclaimer-drawings](http://Logixbrands.com/Disclaimer-drawings) for a full copy of the disclaimer.

Drawing:

9-24

Date:

MAY/2024

Pg:

9

Title:

CHROME GPS® ABOVE GRADE WALL ASSEMBLY & HALO® SUBTERRA® OR SUBTERRA® PLUS SLAB-ON-GRADE DETAIL

WHERE WALLS REQUIRED TO PROVIDE PROTECTION FROM PRECIPITATION COMPRISE CLADDING ASSEMBLIES WITH FIRST & SECOND PLANES OF PROTECTION,

- THE FIRST PLANE OF PROTECTION (CLADDING) SHALL CONSIST OF CLADDING WITH APPROPRIATE TRIM, ACCESSORY PIECES & FASTENERS
- THE SECOND PLANE OF PROTECTION (FRONT FACE OF ICF. ALTERNATIVE DETAIL - MECH. FASTENED, PEEL & STICK, OR LIQUID APPLIED MEMBRANE APPLIED TO FRONT FACE OF ICF BLOCK) SHALL BE DESIGNED & CONSTRUCTED TO:

- INTERCEPT ALL RAIN & SNOW THAT GETS PAST THE FIRST PLANE OF PROTECTION, & EFFECTIVELY DISSIPATE ANY RAIN OR SNOW TO THE EXTERIOR, & THE PROTECTION PROVIDED BY THE FIRST & SECOND PLANES OF PROTECTION SHALL BE MAINTAINED

- AT WALL PENETRATIONS CREATED BY THE INSTALLATION OF COMPONENTS AND SERVICES SUCH AS WINDOWS, DOORS, VENTILATION DUCTS, PIPING, WIRING & ELECTRICAL OUTLETS (NBC 9.27.2.3.)

**BEST PRACTICE:** BUG SCREEN TOP & BOTTOM OF VENTILATED AIR SPACE

FLASHING TAPED OR CAULKED TO FRONT FACE OF ICF

EXTERIOR FOUNDATION WALLS SHALL EXTEND NOT LESS THAN 6" (150MM) ABOVE FINISHED GROUND LEVEL (NBC 9.15.4.6.)

INSULATION ABOVE GRADE CANNOT BE LEFT EXPOSED COVER WITH ACRYLIC PARGING (NBC 9.25.2.3. 6) 7), OPTIONAL GYPSUM OR CONCRETE BOARD

**BEST PRACTICE:** COVER GRANULAR FILL WITH FABRIC CLOTH MIN. 4" (100MM) DIAM. DRAIN TILE OR PIPE (NBC 9.14.3.2.) COVERED WITH NOT LESS THAN 6" (150MM) CRUSHED STONE OR OTHER COARSE CLEAN GRANULAR MATERIAL CONTAINING NOT MORE THAN 10% OF MATERIAL THAT WILL PASS A  $\frac{1}{8}$ " (4MM) SIEVE (NBC 9.14.3.3.4.)

UNDISTURBED SOIL OR BEDROCK

EPS INSULATION FUNCTIONS AS VAPOR CONTROL LAYER FOR THE ASSEMBLY, THERMALLY INSULATED ASSEMBLIES SHALL BE CONSTRUCTED WITH A VAPOUR RETARDER (NBC 9.25.4.1.1.)

INTERIOR GYPSUM BOARD FINISH (NBC 9.29.5.), GLUED TO EPS OF ICF, SCREWED TO ICF WEBS OR INSTALLED ONTOP OF FURRING STRIPS

ICF (NBC TABLE 9.36.2.6.-A OR -B), FOR ADDITIONAL THERMAL RESISTANCE: D-RV, HALO® INTERRA®, OR SUBTERRA®/SUBTERRA® PLUS CAN BE INSTALLED

CONCRETE SLAB & REINFORCEMENT DESIGNED AS PER MIN. BUILDING CODE OR ENGINEER

**BEST PRACTICE:** 1" - 8" (25 - 200MM) HALO® SUBTERRA® OR SUBTERRA® PLUS OR HEAT-SHEET® (NBC TABLE 9.36.2.8.-A OR -B).

**BEST PRACTICE:** RADON EXTRACTION SYSTEM, BARRIER, OR SUBFLOOR DEPRESSURIZATION SYSTEM INSTALLED IN FLOOR ASSEMBLIES SEPARATING CONDITIONED SPACE FROM THE GROUND. NOTE: SUBTERRA® PLUS & HEAT-SHEET® HEAVY CAN FUNCTION AS A PART OF A RADON MITIGATION SYSTEM

**BEST PRACTICE:** SEAL JOINTS OF FOAM INSULATION BELOW SLAB (AIR BARRIER) OR INCLUDE A SHEET APPLIED MEMBRANE IN THE FLOOR ON GROUND & CONNECT TO THE AIR AND/OR VAPOR CONTROL LAYER IN THE ABOVE GRADE WALL

**BEST PRACTICE:** FOOTING BARRIER MEMBRANE AS CAPILLARY BREAK BETWEEN SLAB & ABOVE GRADE WALL

#### 4 BUILDING SCIENCE CONTROL LAYERS

- WATER: FRONT FACE OF ICF BLOCK
  - NOTE: ALTERNATIVE DETAIL; MECHANICALLY FASTENED, PEEL & STICK, OR LIQUID APPLIED MEMBRANE APPLIED TO FRONT FACE OF ICF BLOCK
- AIR: CONCRETE IN ICF TO CONCRETE IN FLOOR SLAB
  - NOTE: BEST PRACTICE TAPE JOINTS OF INSULATION BELOW SLAB AND CONNECT TO CONCRETE IN ICF BLOCK WITH SHEET APPLIED MEMBRANE
- THERMAL: HALO® SUBTERRA® OR SUBTERRA® PLUS OR HEAT-SHEET® BELOW SLAB & INTERIOR & EXTERIOR EPS INSULATION OF ICF BLOCK
- VAPOR: INSULATION BELOW SLAB & INTERIOR EPS INSULATION OF ICF BLOCK

**BEST PRACTICE:** FURRING STRIPS BEHIND CLADDING FOR DRAINAGE & VENTILATION

HEADER FLASHING MIN. 6% SLOPE TAPED OR CAULKED TO EXTERIOR WATER CONTROL LAYER NBC 9.27.3.8.(4)

**BEST PRACTICE:** INCLUDE END DAMS

TAPE OR CAULK WINDOW FLANGE TO ROUGH OPENING AT TOP HORIZONTAL & BOTH VERTICAL FLANGES (LEAVE BOTTOM HORIZONTAL OPEN FOR DRAINAGE)

WRAP ROUGH OPENING OF SILL & MIN. 8" (200MM) UP VERTICAL JAMB WITH PEEL & STICK OR LIQUID APPLIED WATERPROOF MEMBRANE & EXTEND ON TO THE FACE OF THE EXT. SHEATHING OR WATER CONTROL LAYER MIN. 4" (100MM) **BEST PRACTICE:** COVER ENTIRE ROUGH OPENING


ENSURE WINDOW PANE IN-LINE WITH INSULATION IN WALL ASSEMBLY (OFFSET IN DRAWING)

CAULK WINDOW FRAME TO CLADDING NBC 9.27.3.8.(4)

SHIM WINDOW AS & WHERE REQUIRED BY THE WINDOW MANUFACTURER

SHIM BOTTOM FLANGE TO ALLOW DRAINAGE & DO NOT SEAL BOTTOM FLANGE TO ROUGH OPENING MEMBRANE (OPEN FOR DRAINAGE)

WRAP ROUGH OPENING OF SILL & MIN. 8" (200MM) UP VERTICAL JAMB WITH PEEL & STICK OR LIQUID APPLIED WATERPROOF MEMBRANE & EXTEND ON TO THE FACE OF THE EXT. SHEATHING OR WATER CONTROL LAYER MIN. 4" (100MM) **BEST PRACTICE:** COVER ENTIRE ROUGH OPENING

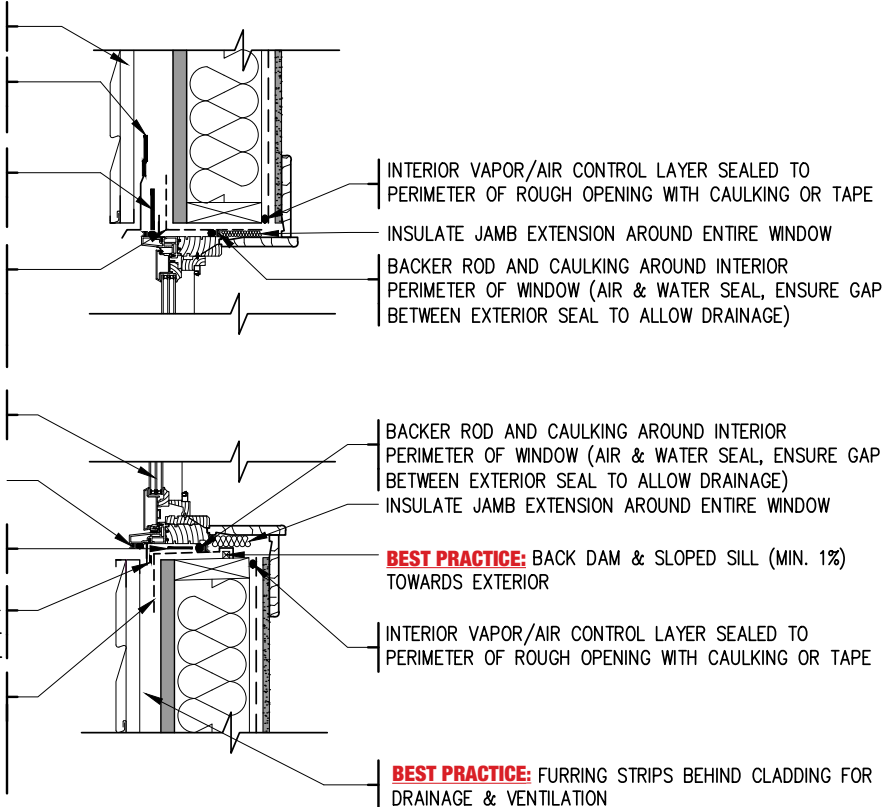

INTERIOR VAPOR/AIR CONTROL LAYER SEALED TO PERIMETER OF ROUGH OPENING WITH CAULKING OR TAPE

INSULATE JAMB EXTENSION AROUND ENTIRE WINDOW

BACKER ROD AND CAULKING AROUND INTERIOR PERIMETER OF WINDOW (AIR & WATER SEAL, ENSURE GAP BETWEEN EXTERIOR SEAL TO ALLOW DRAINAGE)

BACKER ROD AND CAULKING AROUND INTERIOR PERIMETER OF WINDOW (AIR & WATER SEAL, ENSURE GAP BETWEEN EXTERIOR SEAL TO ALLOW DRAINAGE)

INSULATE JAMB EXTENSION AROUND ENTIRE WINDOW

**BEST PRACTICE:** BACK DAM & SLOPED SILL (MIN. 1%) TOWARDS EXTERIOR

INTERIOR VAPOR/AIR CONTROL LAYER SEALED TO PERIMETER OF ROUGH OPENING WITH CAULKING OR TAPE

**BEST PRACTICE:** FURRING STRIPS BEHIND CLADDING FOR DRAINAGE & VENTILATION

4 BUILDING SCIENCE CONTROL LAYERS

- WATER: FRONT FACE HALO® EXTERRA®
  - NOTE: ALTERNATIVE DETAIL; MECHANICALLY FASTENED, PEEL & STICK, OR LIQUID APPLIED MEMBRANE APPLIED TO FRONT FACE OR INBEHIND HALO® EXTERRA®
- AIR: INTERIOR MEMBRANE CONNECTED TO WINDOW VIA MEMBRANE APPLIED TO ROUGH OPENING TO BACKER ROD & CAULKING (INTERIOR AIR SEAL)
  - NOTE: WINDOW MUST CONNECT TO INTERIOR AIR CONTROL LAYER IN ORDER TO MAINTAIN CONTINUOUS AIR BARRIER
- THERMAL: HALO® EXTERRA® & INSULATION BETWEEN STUDS
- VAPOR: INTERIOR MEMBRANE


**BEST PRACTICE:** FURRING STRIPS BEHIND CLADDING FOR DRAINAGE & VENTILATION

HEADER FLASHING MIN. 6% SLOPE TAPED OR CAULKED TO EXTERIOR WATER CONTROL LAYER NBC 9.27.3.8.(4)

**BEST PRACTICE:** INCLUDE END DAMS

TAPE OR CAULK WINDOW FLANGE TO ROUGH OPENING AT TOP HORIZONTAL & BOTH VERTICAL FLANGES (LEAVE BOTTOM HORIZONTAL OPEN FOR DRAINAGE)

WRAP ROUGH OPENING OF SILL & MIN. 8" (200MM) UP VERTICAL JAMB WITH PEEL & STICK OR LIQUID APPLIED WATERPROOF MEMBRANE & EXTEND ON TO THE FACE OF THE EXT SHEATHING OR WATER CONTROL LAYER MIN. 4" (100MM) **BEST PRACTICE:** COVER ENTIRE ROUGH OPENING

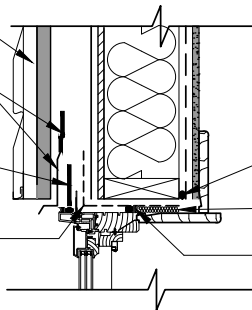

INTERIOR VAPOR/AIR CONTROL LAYER SEALED TO PERIMETER OF ROUGH OPENING WITH CAULKING OR TAPE

INSULATE JAMB EXTENSION AROUND ENTIRE WINDOW

BACKER ROD AND CAULKING AROUND INTERIOR PERIMETER OF WINDOW (AIR & WATER SEAL, ENSURE GAP BETWEEN EXTERIOR SEAL TO ALLOW DRAINAGE)


ENSURE WINDOW PANE IN-LINE WITH INSULATION IN WALL ASSEMBLY (OFFSET IN DRAWING)

CAULK WINDOW FRAME TO CLADDING NBC 9.27.3.8.(4)

SHIM WINDOW AS & WHERE REQUIRED BY THE WINDOW MANUFACTURER

SHIM BOTTOM FLANGE TO ALLOW DRAINAGE & DO NOT SEAL BOTTOM FLANGE TO ROUGH OPENING MEMBRANE

WRAP ROUGH OPENING OF SILL & MIN. 8" (200MM) UP VERTICAL JAMB WITH PEEL & STICK OR LIQUID APPLIED WATERPROOF MEMBRANE & EXTEND ON TO THE FACE OF THE EXT. SHEATHING OR WATER CONTROL LAYER MIN. 4" (100MM) **BEST PRACTICE:** COVER ENTIRE ROUGH OPENING

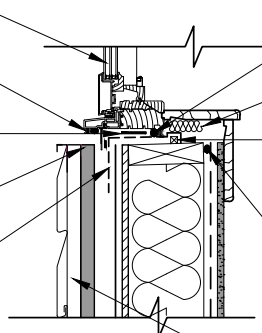

BACKER ROD AND CAULKING AROUND INTERIOR PERIMETER OF WINDOW (AIR & WATER SEAL, ENSURE GAP BETWEEN EXTERIOR SEAL TO ALLOW DRAINAGE)

INSULATE JAMB EXTENSION AROUND ENTIRE WINDOW

**BEST PRACTICE:** BACK DAM & SLOPED SILL (MIN. 1%) TOWARDS EXTERIOR

INTERIOR VAPOR/AIR CONTROL LAYER SEALED TO PERIMETER OF ROUGH OPENING WITH CAULKING OR TAPE

**BEST PRACTICE:** FURRING STRIPS BEHIND CLADDING FOR DRAINAGE & VENTILATION

**4 BUILDING SCIENCE CONTROL LAYERS**

- WATER: MEMBRANE APPLIED TO EXTERIOR SHEATHING
- AIR: INTERIOR MEMBRANE CONNECTED TO WINDOW VIA MEMBRANE APPLIED TO ROUGH OPENING TO BACKER ROD & CAULKING (INTERIOR AIR SEAL)
- NOTE: WINDOW MUST CONNECT TO INTERIOR AIR CONTROL LAYER IN ORDER TO MAINTAIN CONTINUOUS AIR BARRIER
- THERMAL: CHROME GPS® & INSULATION BETWEEN STUDS
- VAPOR: INTERIOR MEMBRANE


**BEST PRACTICE:** FURRING STRIPS BEHIND CLADDING FOR DRAINAGE & VENTILATION

HEADER FLASHING MIN. 6% SLOPE TAPED OR CAULKED TO EXTERIOR WATER CONTROL LAYER NBC 9.27.3.8.(4)

**BEST PRACTICE:** INCLUDE END DAMS

TAPE OR CAULK WINDOW FLANGE TO ROUGH OPENING AT TOP HORIZONTAL & BOTH VERTICAL FLANGES (LEAVE BOTTOM HORIZONTAL OPEN FOR DRAINAGE)

WRAP ROUGH OPENING OF SILL & MIN. 8" (200MM) UP VERTICAL JAMB WITH PEEL & STICK OR LIQUID APPLIED WATERPROOF MEMBRANE & EXTEND ON TO THE FACE OF THE EXT. SHEATHING WATER CONTROL LAYER MIN. 4" (100MM) **BEST PRACTICE:** COVER ENTIRE ROUGH OPENING

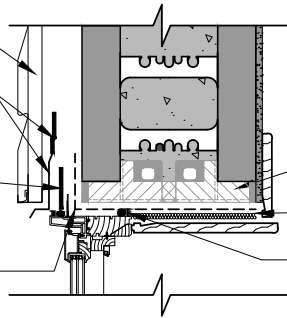

**BEST PRACTICE:** PRO BUCK® BY LOGIX BRANDS (WINDOW TO WALL THERMAL BREAK)

INSULATE JAMB EXTENSION AROUND ENTIRE WINDOW

BACKER ROD AND CAULKING AROUND INTERIOR PERIMETER OF WINDOW (AIR & WATER SEAL, ENSURE GAP BETWEEN EXTERIOR SEAL TO ALLOW DRAINAGE)


ENSURE WINDOW PANE IN-LINE WITH INSULATION IN WALL ASSEMBLY (OFFSET IN DRAWING)

CAULK WINDOW FRAME TO CLADDING NBC 9.27.3.8.(4)

SHIM WINDOW AS & WHERE REQUIRED BY THE WINDOW MANUFACTURER

SHIM BOTTOM FLANGE OF WINDOW TO ALLOW DRAINAGE & DO NOT SEAL BOTTOM FLANGE TO ROUGH OPENING MEMBRANE (OPEN FOR DRAINAGE)

WRAP ROUGH OPENING OF SILL & MIN. 8" (200MM) UP VERTICAL JAMB WITH PEEL & STICK OR LIQUID APPLIED WATERPROOF MEMBRANE & EXTEND ON TO THE FACE OF THE EXT. SHEATHING OR WATER CONTROL LAYER MIN. 4" (100MM) **BEST PRACTICE:** COVER ENTIRE ROUGH OPENING

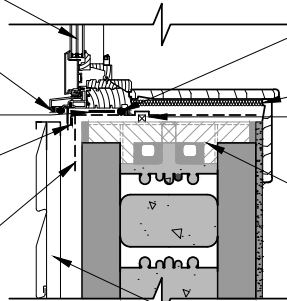

BACKER ROD AND CAULKING AROUND INTERIOR PERIMETER OF WINDOW (AIR & WATER SEAL, ENSURE GAP BETWEEN EXTERIOR SEAL TO ALLOW DRAINAGE)

INSULATE JAMB EXTENSION AROUND ENTIRE WINDOW


**BEST PRACTICE:** BACK DAM & SLOPED SILL (MIN. 1% TOWARDS EXTERIOR)

**BEST PRACTICE:** PRO BUCK® BY LOGIX BRANDS (WINDOW TO WALL THERMAL BREAK)

**BEST PRACTICE:** FURRING STRIPS BEHIND CLADDING FOR DRAINAGE & VENTILATION

**4 BUILDING SCIENCE CONTROL LAYERS**

- WATER: FRONT FACE OF ICF BLOCK
  - NOTE: ALTERNATIVE DETAIL; MECHANICALLY FASTENED, PEEL & STICK, OR LIQUID APPLIED MEMBRANE APPLIED TO FRONT FACE OF ICF BLOCK
- AIR: CONCRETE IN ICF CONNECTED TO WINDOW VIA MEMBRANE APPLIED TO ROUGH OPENING TO BACKER ROD & CAULKING (INT. AIR SEAL)
  - NOTE: WINDOW MUST CONNECT TO CONCRETE IN ORDER TO MAINTAIN CONTINUOUS AIR BARRIER. ALTERNATIVE DETAIL AIR CONTROL LAYER; MECHANICALLY FASTENED, PEEL & STICK, OR LIQUID APPLIED MEMBRANE APPLIED TO INTERIOR OR EXTERIOR OF ICF BLOCK
- THERMAL: EXTERIOR & INTERIOR EPS INSULATION OF ICF BLOCK
- VAPOR: INTERIOR EPS INSULATION OF ICF BLOCK

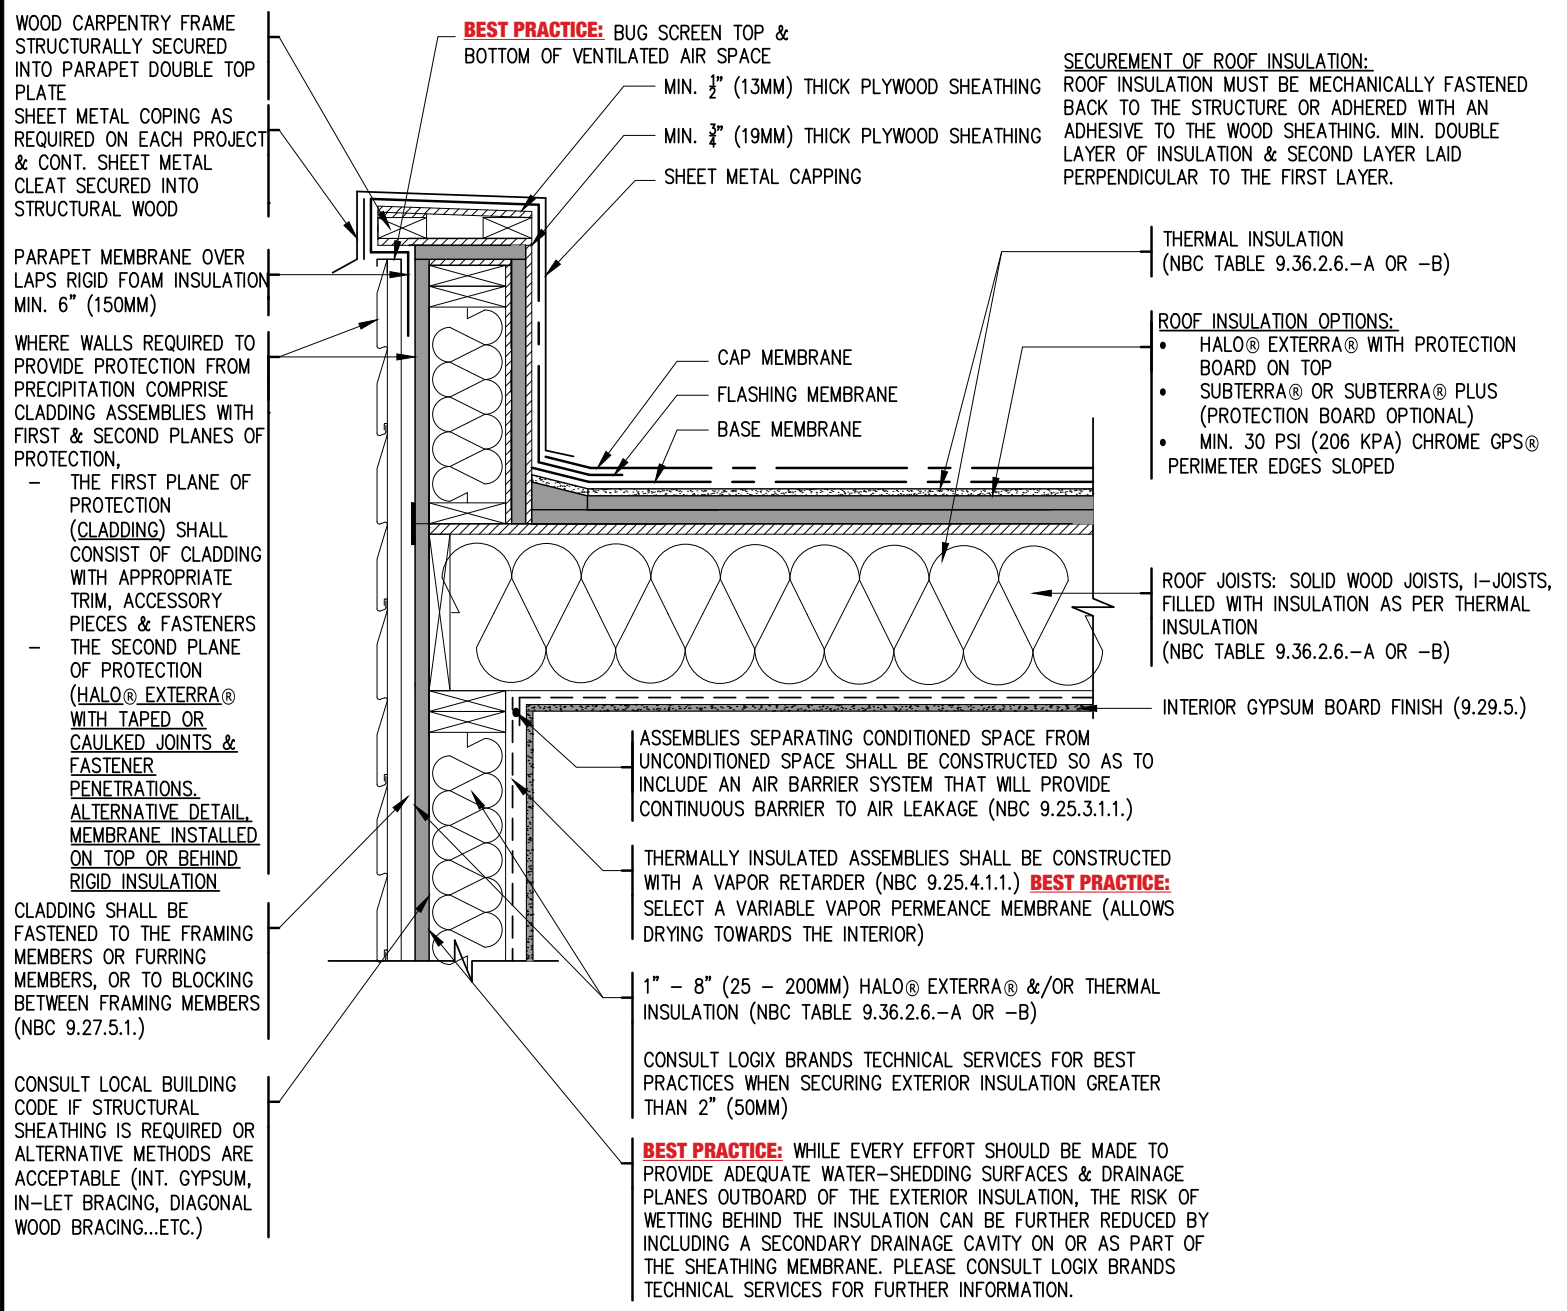

**4 BUILDING SCIENCE CONTROL LAYERS**

- WATER:NON-VAPOR PERMEABLE ROOF MEMBRANE CONNECTING TO FRONT FACE OF HALO® EXTERRA®
- AIR:INTERIOR CEILING MEMBRANE CONNECTING TO INTERIOR ABOVE GRADE WALL MEMBRANE
- THERMAL:HALO® EXTERRA®, SUBTERRA® OR SUBTERRA® PLUS OR CHROME GPS® IN ROOF & HALO® EXTERRA® ON ABOVE GRADE WALL
- VAPOR:INTERIOR CEILING MEMBRANE & INTERIOR ABOVE GRADE WALL MEMBRANE
- NOTE: BEST PRACTICE SELECT VARIABLE VAPOR PERMEANCE MEMBRANE IN CEILING ASSEMBLY (ALLOWS DRYING TOWARDS INTERIOR)

WOOD CARPENTRY FRAME STRUCTURALLY SECURED INTO PARAPET DOUBLE TOP PLATE  
SHEET METAL COPING AS REQUIRED ON EACH PROJECT & CONT. SHEET METAL CLEAT SECURED INTO STRUCTURAL WOOD


PARAPET MEMBRANE OVER LAPS RIGID FOAM INSULATION MIN. 6" (150MM)

WHERE WALLS REQUIRED TO PROVIDE PROTECTION FROM PRECIPITATION COMPRISE CLADDING ASSEMBLIES WITH FIRST & SECOND PLANES OF PROTECTION,

- THE FIRST PLANE OF PROTECTION (CLADDING) SHALL CONSIST OF CLADDING WITH APPROPRIATE TRIM, ACCESSORY PIECES & FASTENERS
- THE SECOND PLANE OF PROTECTION (MECHANICALLY FASTENED, SELF-ADHERED, OR LIQUID APPLIED MEMBRANE (VAPOUR PERMEABLE) APPLIED ON TOP OF EXT. SHEATHING)

CLADDING SHALL BE FASTENED TO THE FRAMING MEMBERS OR FURRING MEMBERS, OR TO BLOCKING BETWEEN FRAMING MEMBERS (NBC 9.27.5.1.)

**BEST PRACTICE:** BUG SCREEN TOP & BOTTOM OF VENTILATED AIR SPACE

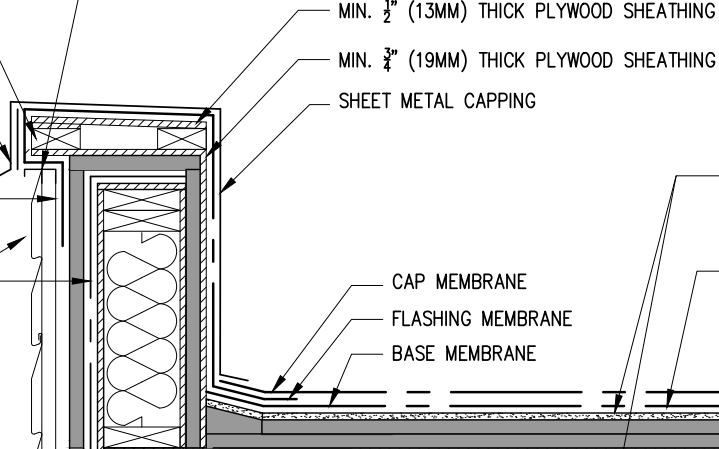

**SECUREMENT OF ROOF INSULATION:**  
ROOF INSULATION MUST BE MECHANICALLY FASTENED BACK TO THE STRUCTURE OR ADHERED WITH AN ADHESIVE TO THE WOOD SHEATHING. MIN. DOUBLE LAYER OF INSULATION & SECOND LAYER LAID PERPENDICULAR TO THE FIRST LAYER.

THERMAL INSULATION (NBC TABLE 9.36.2.6.-A OR -B)

- ROOF INSULATION OPTIONS:**
- HALO® EXTERRA® WITH PROTECTION BOARD ON TOP
  - SUBTERRA® OR SUBTERRA® PLUS (PROTECTION BOARD OPTIONAL)
  - MIN. 30 PSI (206 KPA) CHROME GPS® PERIMETER EDGES SLOPED

ROOF JOISTS: SOLID WOOD JOISTS, I-JOISTS, FILLED WITH INSULATION AS PER THERMAL INSULATION (NBC TABLE 9.36.2.6.-A OR -B)

INTERIOR GYPSUM BOARD FINISH (9.29.5.)

ASSEMBLIES SEPARATING CONDITIONED SPACE FROM UNCONDITIONED SPACE SHALL BE CONSTRUCTED SO AS TO INCLUDE AN AIR BARRIER SYSTEM THAT WILL PROVIDE CONTINUOUS BARRIER TO AIR LEAKAGE (NBC 9.25.3.1.1.)

THERMALLY INSULATED ASSEMBLIES SHALL BE CONSTRUCTED WITH A VAPOR RETARDER (NBC 9.25.4.1.1.) **BEST PRACTICE:** SELECT A VARIABLE VAPOR PERMEANCE MEMBRANE (ALLOWS DRYING TOWARDS THE INTERIOR)

1" - 8" (25 - 200MM) CHROME GPS® &/OR THERMAL INSULATION (NBC TABLE 9.36.2.6.-A OR -B)

CONSULT LOGIX BRANDS TECHNICAL SERVICES FOR BEST PRACTICES WHEN SECURING EXTERIOR INSULATION GREATER THAN 2" (50MM)

**BEST PRACTICE:** WHILE EVERY EFFORT SHOULD BE MADE TO PROVIDE ADEQUATE WATER-SHEDDING SURFACES & DRAINAGE PLANES OUTBOARD OF THE EXTERIOR INSULATION, THE RISK OF WETTING BEHIND THE INSULATION CAN BE FURTHER REDUCED BY INCLUDING A SECONDARY DRAINAGE CAVITY ON OR AS PART OF THE SHEATHING MEMBRANE. PLEASE CONSULT LOGIX BRANDS TECHNICAL SERVICES FOR FURTHER INFORMATION.

**4 BUILDING SCIENCE CONTROL LAYERS**

- WATER: NON-VAPOR PERMEABLE ROOF MEMBRANE CONNECTING TO MECHANICALLY FASTENED, PEEL & STICK, OR LIQUID APPLIED MEMBRANE ON EXTERIOR SHEATHING
  - NOTE: MEMBRANE COULD FUNCTION AS AIR CONTROL LAYER & INTERIOR MEMBRANE AS THE AIR CONTROL LAYER COULD BE OMITTED (STILL REQUIRES VAPOR CONTROL LAYER WARM SIDE OF WALL ASSEMBLY)
- AIR: INTERIOR CEILING MEMBRANE CONNECTING TO INTERIOR ABOVE GRADE WALL MEMBRANE
- THERMAL: HALO® EXTERRA®, SUBTERRA® OR SUBTERRA® PLUS OR CHROME GPS® IN ROOF & CHROME GPS® ON ABOVE GRADE WALL
- VAPOUR: INTERIOR CEILING MEMBRANE & INTERIOR ABOVE GRADE WALL MEMBRANE OR IF INTERIOR MEMBRANE OMITTED WHEN AIR CONTROL LAYER IS PLACED ON THE EXTERIOR OF THE BUILDING ENCLOSURE A VAPOR RETARDING PAINT CAN BE APPLIED TO THE GYPSUM BOARD
  - NOTE: BEST PRACTICE SELECT VARIABLE VAPOR PERMEANCE MEMBRANE IN CEILING ASSEMBLY (ALLOWS DRYING TOWARDS INTERIOR)



© Copyright Logix Brands Ltd. (2024) All rights reserved. No part of the work contained herein as covered by this copyright may be reproduced or used in any form, or any means - graphic, electronic or mechanical, including without limitation photocopying. By using these drawings, you agree to assume all risks associated therewith. See [Logixbrands.com/Disclaimer-drawings](https://Logixbrands.com/Disclaimer-drawings) for a full copy of the disclaimer.

Drawing: <b>15-24</b>	Date: <b>MAY/2024</b>	Pg: <b>15</b>
--------------------------	--------------------------	------------------

Title:  
**CHROME GPS® ABOVE GRADE WALL ASSEMBLY & SELF-ADHERED FLAT ROOF ASSEMBLY**

WOOD CARPENTRY FRAME STRUCTURALLY SECURED INTO ICF

SHEET METAL COPING AS REQUIRED ON EACH PROJECT & CONT. SHEET METAL CLEAT SECURED INTO STRUCTURAL WOOD


PARAPET MEMBRANE OVER LAPS RIGID FOAM INSULATION MIN. 6" (150MM)

WHERE WALLS REQUIRED TO PROVIDE PROTECTION FROM PRECIPITATION COMPRISE CLADDING ASSEMBLIES WITH FIRST & SECOND PLANES OF PROTECTION,

- THE FIRST PLANE OF PROTECTION (CLADDING) SHALL CONSIST OF CLADDING WITH APPROPRIATE TRIM, ACCESSORY PIECES & FASTENERS
- THE SECOND PLANE OF PROTECTION (FRONT FACE OF ICF. ALTERNATIVE DETAIL MECH. FASTENED, PEEL & STICK, OR LIQUID APPLIED MEMBRANE APPLIED TO FRONT FACE OF ICF BLOCK) SHALL BE DESIGNED & CONSTRUCTED TO:

--- INTERCEPT ALL RAIN & SNOW THAT GETS PAST THE FIRST PLANE OF PROTECTION, & EFFECTIVELY DISSIPATE ANY RAIN OR SNOW TO THE EXTERIOR, & THE PROTECTION PROVIDED BY THE FIRST & SECOND PLANES PROTECTION SHALL BE MAINTAINED

--- AT WALL PENETRATIONS CREATED BY THE INSTALLATION OF COMPONENTS AND SERVICES SUCH AS WINDOWS, DOORS, VENTILATION DUCTS, PIPING, WIRING & ELECTRICAL OUTLETS (NBC 9.27.2.3.)

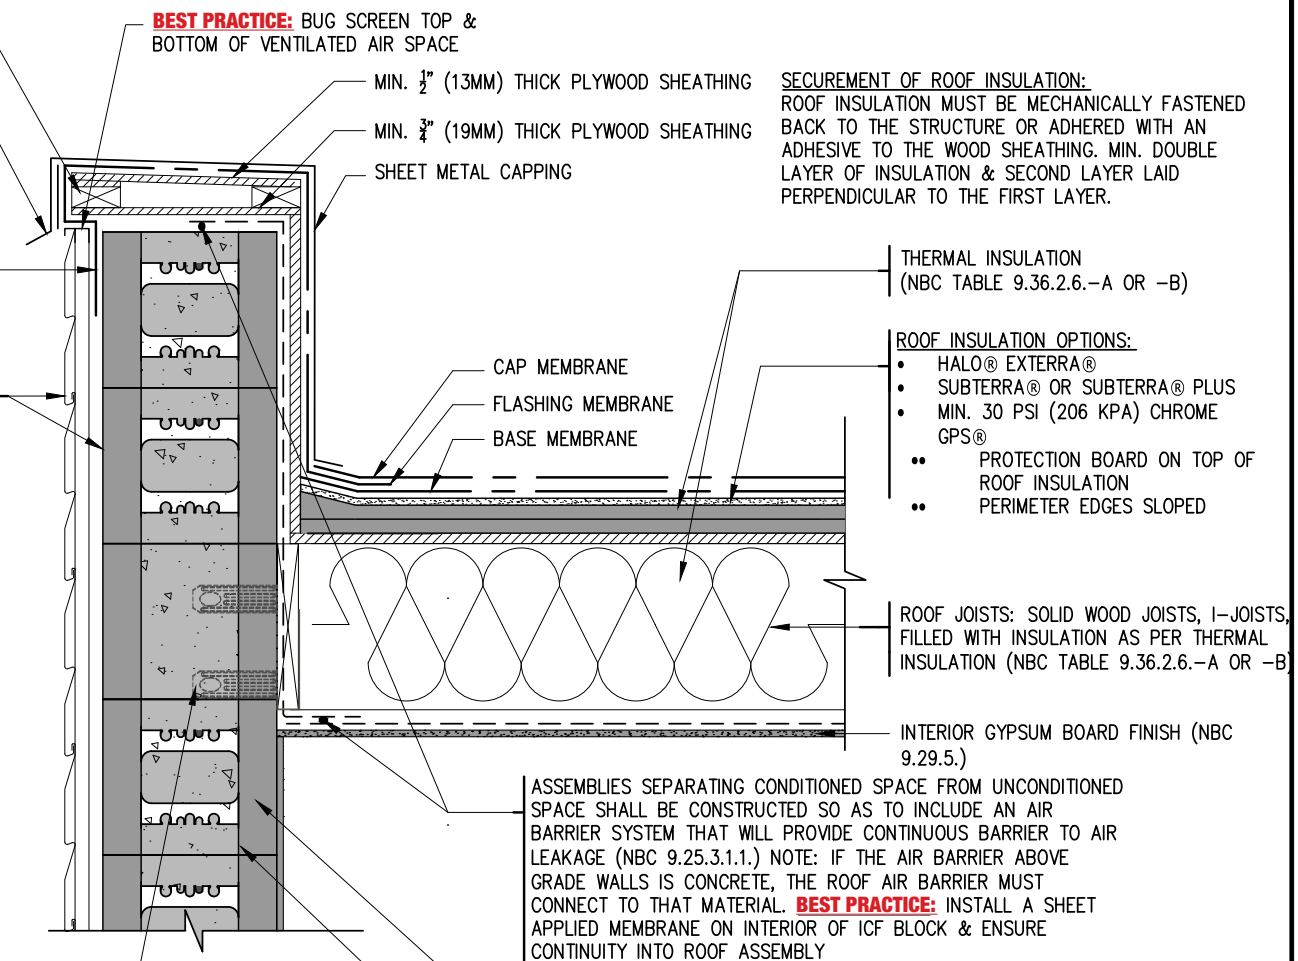

**BEST PRACTICE:** BUG SCREEN TOP & BOTTOM OF VENTILATED AIR SPACE

MIN. 1/2" (13MM) THICK PLYWOOD SHEATHING

MIN. 3/4" (19MM) THICK PLYWOOD SHEATHING

SHEET METAL CAPPING

**SECUREMENT OF ROOF INSULATION:** ROOF INSULATION MUST BE MECHANICALLY FASTENED BACK TO THE STRUCTURE OR ADHERED WITH AN ADHESIVE TO THE WOOD SHEATHING. MIN. DOUBLE LAYER OF INSULATION & SECOND LAYER LAID PERPENDICULAR TO THE FIRST LAYER.

THEMAL INSULATION (NBC TABLE 9.36.2.6.-A OR -B)

- ROOF INSULATION OPTIONS:**
- HALO® EXTERRA®
  - SUBTERRA® OR SUBTERRA® PLUS
  - MIN. 30 PSI (206 KPA) CHROME GPS®
  - PROTECTION BOARD ON TOP OF ROOF INSULATION
  - PERIMETER EDGES SLOPED

ROOF JOISTS: SOLID WOOD JOISTS, I-JOISTS, FILLED WITH INSULATION AS PER THERMAL INSULATION (NBC TABLE 9.36.2.6.-A OR -B)

INTERIOR GYPSUM BOARD FINISH (NBC 9.29.5.)

ASSEMBLIES SEPARATING CONDITIONED SPACE FROM UNCONDITIONED SPACE SHALL BE CONSTRUCTED SO AS TO INCLUDE AN AIR BARRIER SYSTEM THAT WILL PROVIDE CONTINUOUS BARRIER TO AIR LEAKAGE (NBC 9.25.3.1.1.) NOTE: IF THE AIR BARRIER ABOVE GRADE WALLS IS CONCRETE, THE ROOF AIR BARRIER MUST CONNECT TO THAT MATERIAL. **BEST PRACTICE:** INSTALL A SHEET APPLIED MEMBRANE ON INTERIOR OF ICF BLOCK & ENSURE CONTINUITY INTO ROOF ASSEMBLY

EPS INSULATION CAN FUNCTION AS VAPOR CONTROL LAYER FOR THE ASSEMBLY, THERMALLY INSULATED ASSEMBLIES SHALL BE CONSTRUCTED WITH A VAPOR RETARDER (NBC 9.25.4.1.1.)

ICF (NBC TABLE 9.36.2.6.-A OR -B)

FOR ADDITIONAL THERMAL RESISTANCE: D-RV, HALO® INTERRA®, OR SUBTERRA®/SUBTERRA® PLUS CAN BE INSTALLED

SIMPSON STRONGTIE ICF LEDGER CONNECTOR (WEB TIES REMOVED FOR CLARITY)


**4 BUILDING SCIENCE CONTROL LAYERS**

- WATER: NON-VAPOR PERMEABLE ROOF MEMBRANE CONNECTING TO FRONT FACE OF ICF BLOCK
- AIR: INTERIOR CEILING MEMBRANE CONNECTING TO CONCRETE OF ICF BLOCK
- THERMAL: HALO® EXTERRA®, SUBTERRA® OR SUBTERRA® PLUS OR CHROME GPS® IN ROOF & INTERIOR & EXTERIOR INSULATION OF ICF BLOCK
- VAPOR: INTERIOR CEILING MEMBRANE & INTERIOR EPS INSULATION OF ICF BLOCK
- NOTE: BEST PRACTICE SELECT VARIABLE VAPOUR PERMEANCE MEMBRANE IN CEILING ASSEMBLY (ALLOWS DRYING TOWARDS INTERIOR)


LogixBrands.com 1-866-944-0153

© Copyright Logix Brands Ltd. (2024) All rights reserved. No part of the work contained herein as covered by this copyright may be reproduced or used in any form, or any means - graphic, electronic or mechanical, including without limitation photocopying. By using these drawings, you agree to assume all risks associated therewith. See [Logixbrands.com/Disclaimer-drawings](http://Logixbrands.com/Disclaimer-drawings) for a full copy of the disclaimer.


Drawing: <b>16-24</b>	Date: <b>MAY/2024</b>	Pg: <b>16</b>
Title: <b>ICF WALL ASSEMBLY &amp; SELF-ADHERED FLAT ROOF ASSEMBLY</b>		

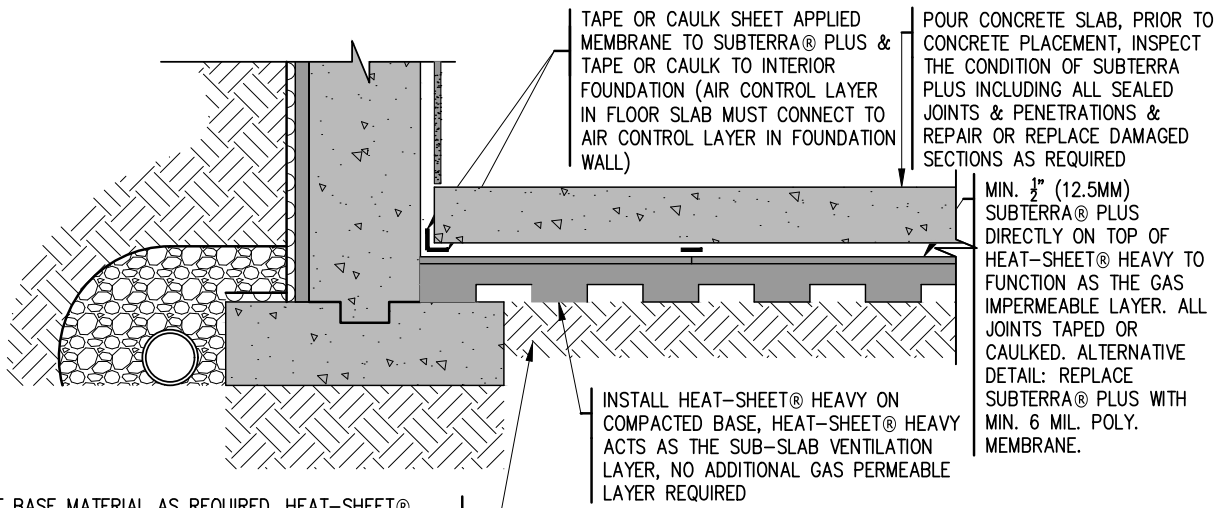




LEVEL & COMPACT BASE MATERIAL AS REQUIRED. HEAT-SHEET® HEAVY CAN BE PLACED DIRECTLY ON UNDISTURBED SOIL, COMPACTED FILL OR SAND

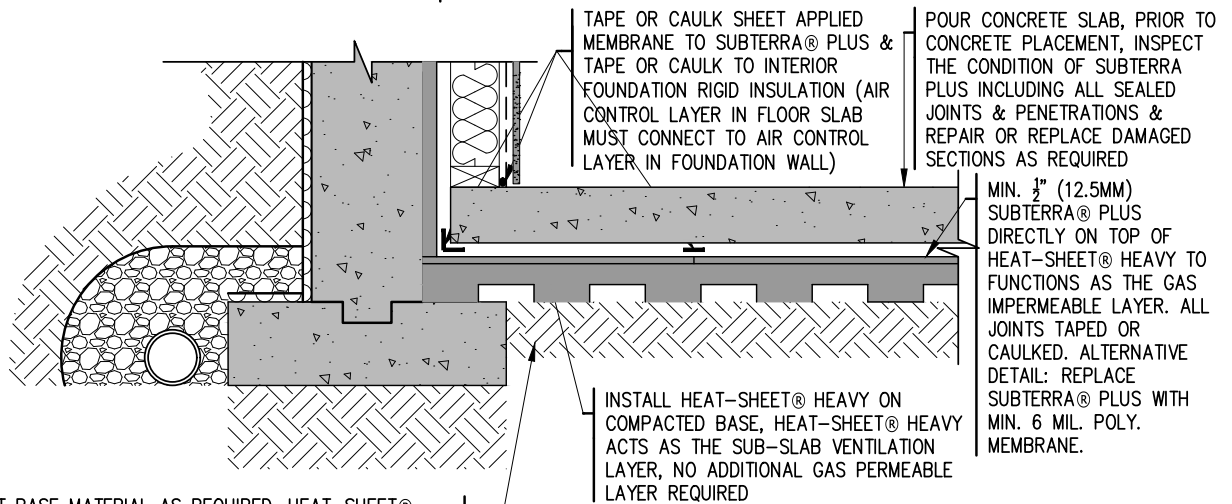


LEVEL & COMPACT BASE MATERIAL AS REQUIRED. HEAT-SHEET® HEAVY CAN BE PLACED DIRECTLY ON UNDISTURBED SOIL, COMPACTED FILL OR SAND

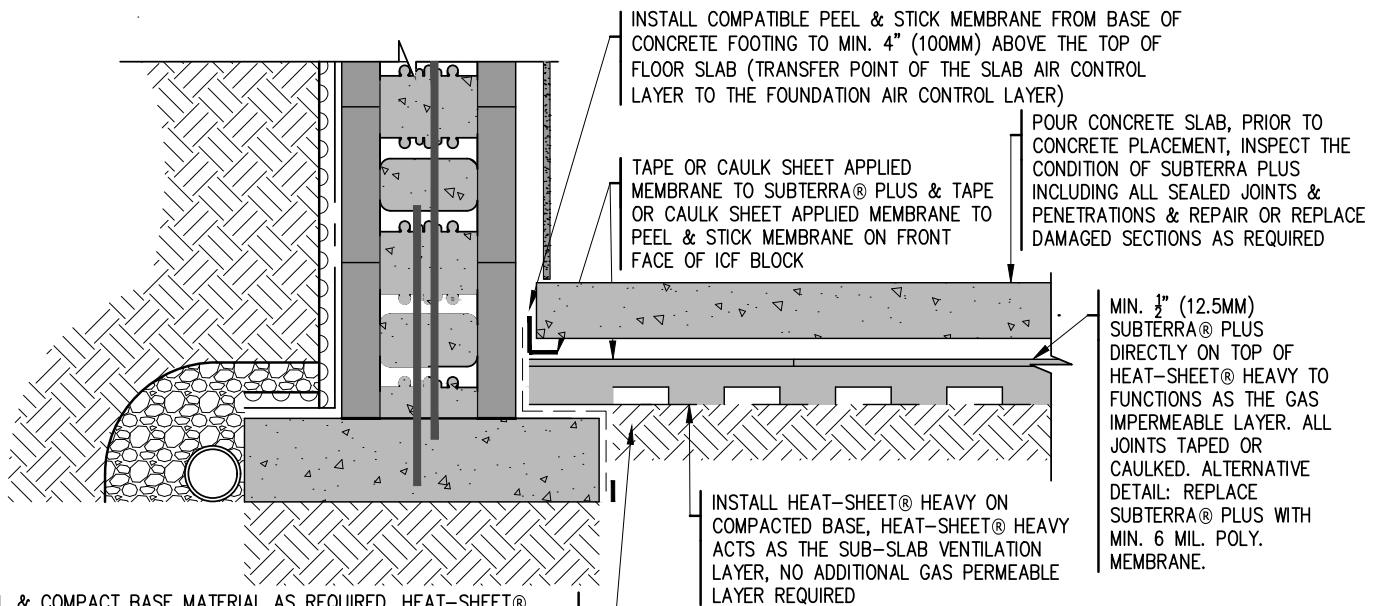


LEVEL & COMPACT BASE MATERIAL AS REQUIRED. HEAT-SHEET® HEAVY CAN BE PLACED DIRECTLY ON UNDISTURBED SOIL, COMPACTED FILL OR SAND

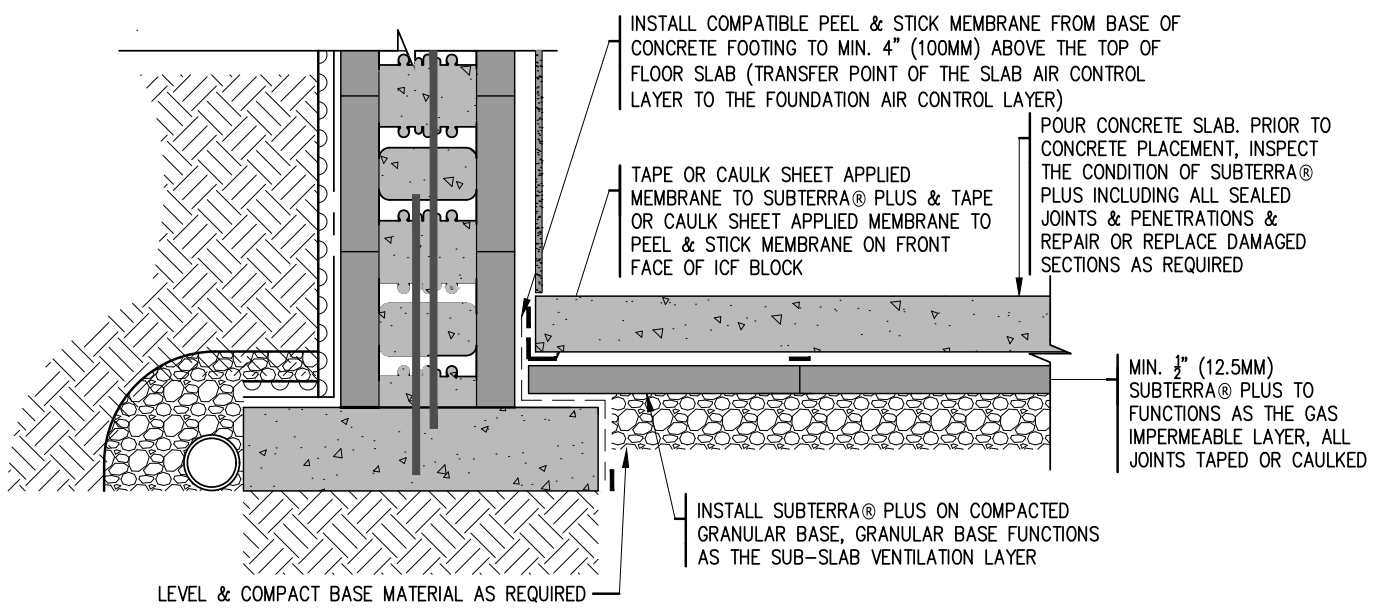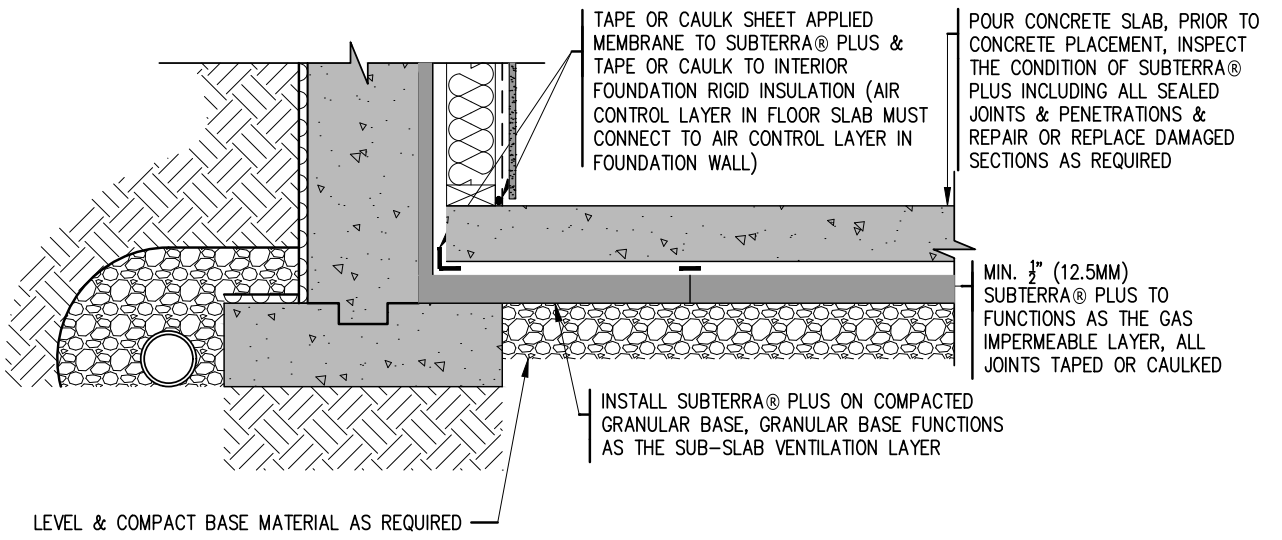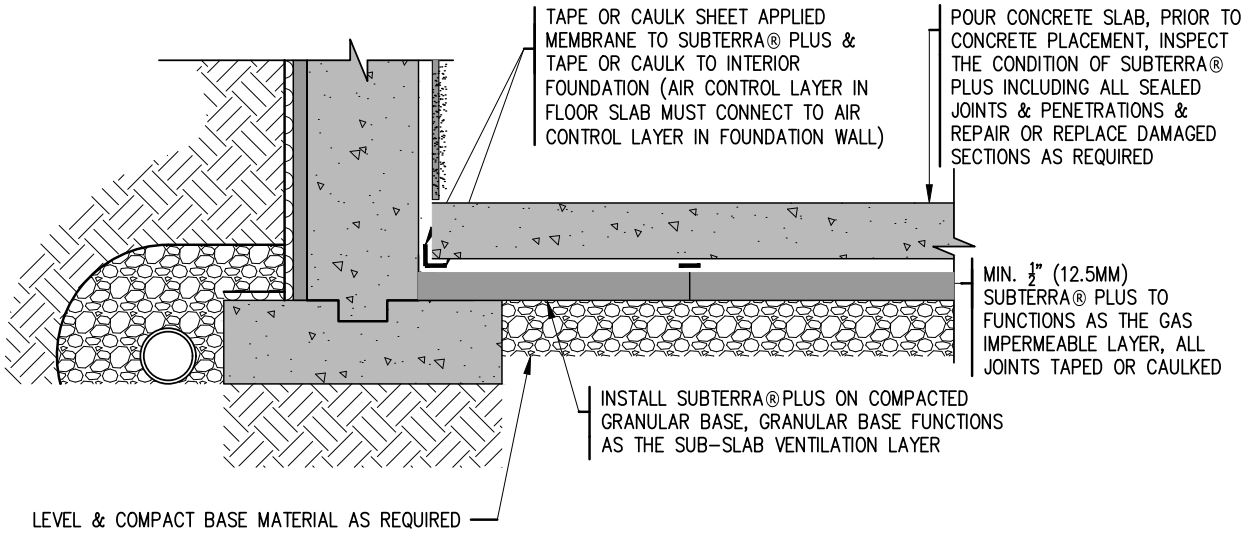

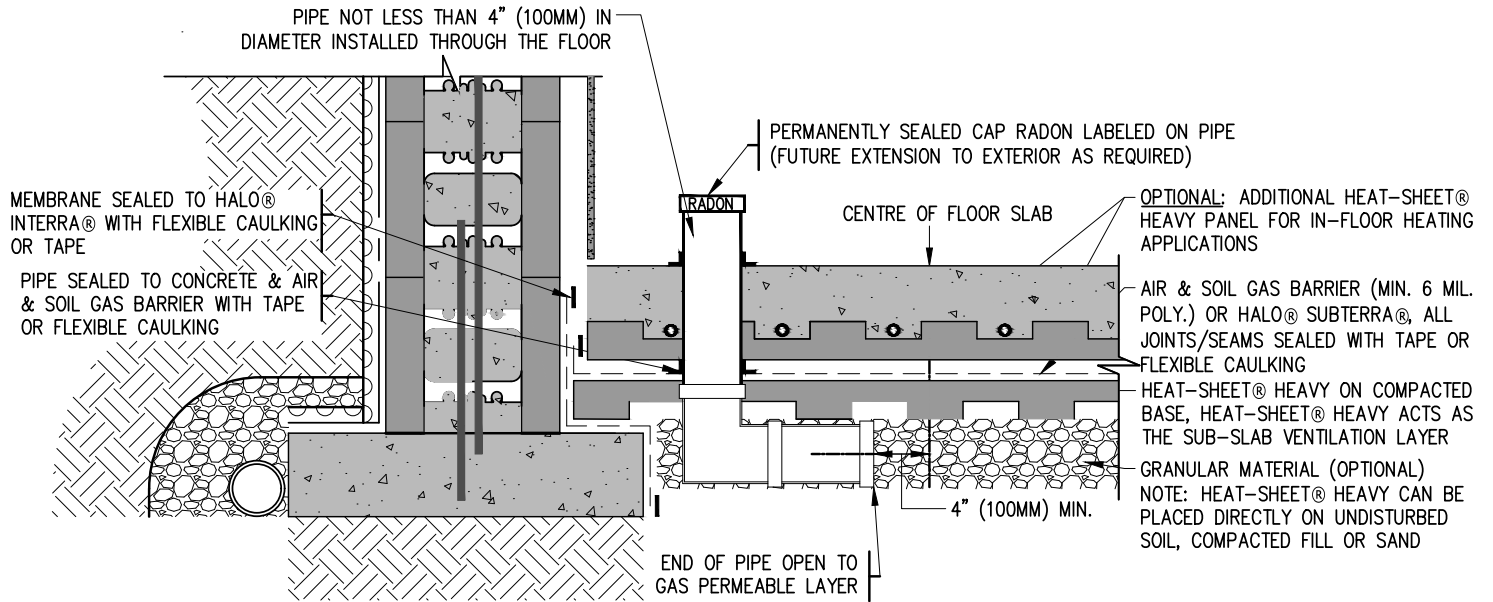


- NOTES:
- RADON PIPE CAN BE VENTED THROUGH CEILING/ROOF TO THE EXTERIOR OR THROUGH FOUNDATION WALL TO THE EXTERIOR. EXHAUST FAN MUST BE LOCATED NEAR THE OUTLET.
  - THE FOLLOWING REQUIREMENTS ARE THE SUGGESTED MINIMUM SETBACKS/CLEARANCES FROM A PASSIVE RADON STACK TERMINATION CLEARANCE FOR ROOF TOP DISCHARGE:
    - VERTICAL CLEARANCE ABOVE THE ROOF AT THE POINT OF PENETRATION 1 FT. (0.3M)
    - VERTICAL CLEARANCE ABOVE WINDOWS OR DOORS 2 FT. 0.6 M
    - VERTICAL CLEARANCE ABOVE MECHANICAL AIR SUPPLY INLET (AIR INTAKE) 3 FT. (0.9M)
    - HORIZONTAL CLEARANCE FROM WINDOWS, DOORS, OR MECHANICAL AIR SUPPLY INLET 10 FT. (3.0M)
    - CLEARANCE HORIZONTALLY FROM A VERTICAL WALL THAT EXTENDS ABOVE THE ROOF PENETRATED 10 FT. (3.0M)
  - THE FOLLOWING REQUIREMENTS ARE THE SUGGESTED MINIMUM SETBACKS/CLEARANCES FOR ACTIVE RADON REDUCTION SYSTEMS:
    - CLEARANCE TO A MECHANICAL AIR SUPPLY INLET MIN. 6-1/2 FT., SUGGESTED 10 FT. (2.0M, 3.0M)
    - CLEARANCE TO PERMANENTLY CLOSED WINDOW MIN. 2 FT, SUGGESTED 3-1/2 FT. (0.6M, 1.0M)
    - CLEARANCE TO A OPENABLE WINDOW MIN./SUGGESTED 6-1/2 FT. (2.0M)
    - CLEARANCE FROM A DOOR THAT MAY BE OPENED MIN. 3-1/2 FT., SUGGESTED 6-1/2 FT. (1.0M, 2.0M)
    - CLEARANCE TO OUTSIDE CORNER MIN./SUGGESTED 1 FT. (0.3M)
    - CLEARANCE TO INSIDE CORNER MIN./SUGGESTED 1 FT. (0.3M)
    - CLEARANCE ABOVE PAVED SIDEWALK OR PAVED DRIVEWAY LOCATED ON PUBLIC PROPERTY MIN./SUGGESTED 6-1/2 FT. (2.0M)
    - CLEARANCE ABOVE GRADE, VERANDA, PORCH, DECK, OR BALCONY MIN. 1 FT., SUGGESTED 3-1/2 FT. (0.3M, 1.0M)
    - VERTICAL CLEARANCE BELOW SOFFITS OR FROM ANY ATTIC VENTING COMPONENT MIN./SUGGESTED 3-1/2 FT. (1.0M)
    - HORIZONTAL CLEARANCE FROM AN AREA DIRECTLY BELOW THE DISCHARGE WHERE THERE IS A RISK OF INJURY FROM ICE FALL MIN. 3-1/2 FT., SUGGESTED 6-1/2 FT. (1.0M, 2.0M)
  - THE COMPLETION OF A SUBFLOOR DEPRESSURIZATION SYSTEM MAY BE NECESSARY TO REDUCE THE RADON CONCENTRATION TO A LEVEL BELOW THE GUIDELINE SPECIFIED BY HEALTH CANADA.
  - FURTHER INFORMATION ON PROTECTION FROM RADON INGRESS CAN BE FOUND IN THE FOLLOWING HEALTH CANADA PUBLICATIONS:
    - RADON: A GUIDE FOR CANADIAN HOMEOWNERS (CMHC/HC), &
    - RADON: REDUCTION GUIDE FOR CANADIANS, &
    - GUIDE FOR RADON MEASUREMENTS IN RESIDENTIAL DWELLINGS (HOMES)

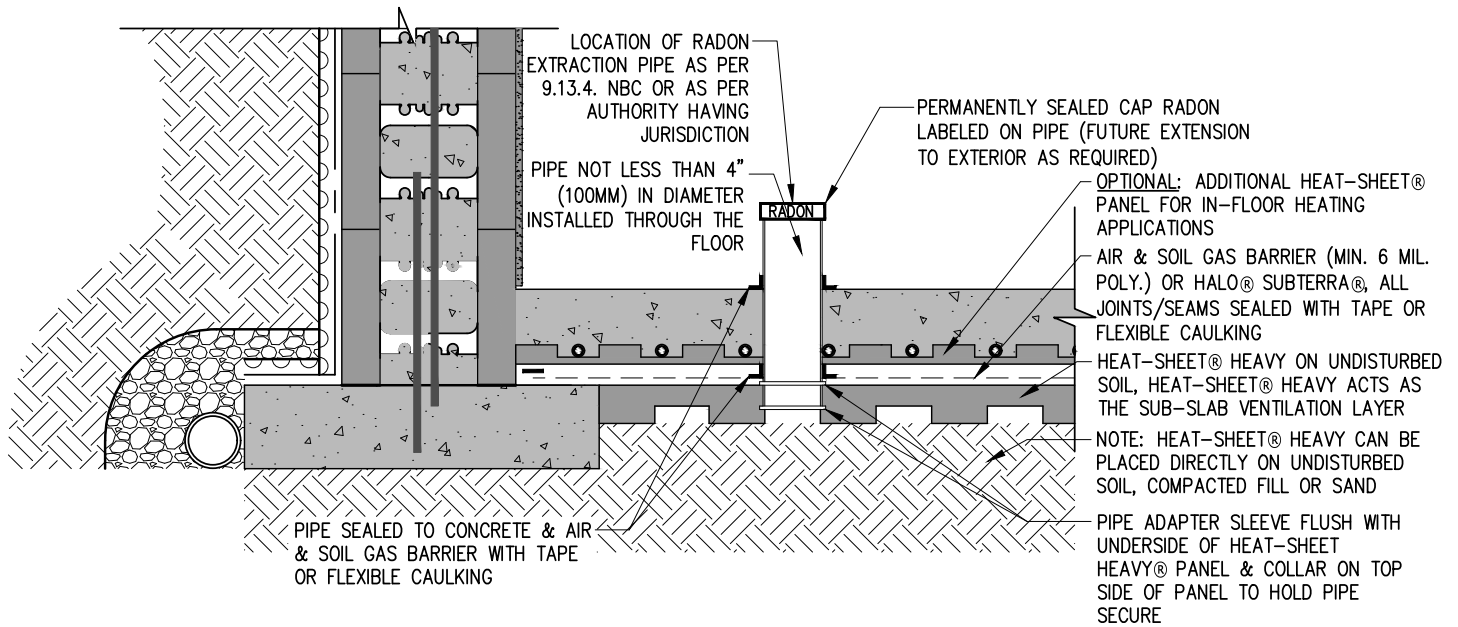


**NOTES:**

- RADON PIPE CAN BE VENTED THROUGH CEILING/ROOF TO THE EXTERIOR OR THROUGH FOUNDATION WALL TO THE EXTERIOR. EXHAUST FAN MUST BE LOCATED NEAR THE OUTLET.
- THE FOLLOWING REQUIREMENTS ARE THE SUGGESTED MINIMUM SETBACKS/CLEARANCES FROM A PASSIVE RADON STACK TERMINATION CLEARANCE FOR ROOF TOP DISCHARGE:
  - VERTICAL CLEARANCE ABOVE THE ROOF AT THE POINT OF PENETRATION 1 FT. (0.3M)
  - VERTICAL CLEARANCE ABOVE WINDOWS OR DOORS 2 FT. 0.6 M
  - VERTICAL CLEARANCE ABOVE MECHANICAL AIR SUPPLY INLET (AIR INTAKE) 3 FT. (0.9M)
  - HORIZONTAL CLEARANCE FROM WINDOWS, DOORS, OR MECHANICAL AIR SUPPLY INLET 10 FT. (3.0M)
  - CLEARANCE HORIZONTALLY FROM A VERTICAL WALL THAT EXTENDS ABOVE THE ROOF PENETRATED 10 FT. (3.0M)
- THE FOLLOWING REQUIREMENTS ARE THE SUGGESTED MINIMUM SETBACKS/CLEARANCES FOR ACTIVE RADON REDUCTION SYSTEMS:
  - CLEARANCE TO A MECHANICAL AIR SUPPLY INLET MIN. 6-1/2 FT., SUGGESTED 10 FT. (2.0M, 3.0M)
  - CLEARANCE TO PERMANENTLY CLOSED WINDOW MIN. 2 FT, SUGGESTED 3-1/2 FT. (0.6M, 1.0M)
  - CLEARANCE TO A OPENABLE WINDOW MIN./SUGGESTED 6-1/2 FT. (2.0M)
  - CLEARANCE FROM A DOOR THAT MAY BE OPENED MIN. 3-1/2 FT., SUGGESTED 6-1/2 FT. (1.0M, 2.0M)
  - CLEARANCE TO OUTSIDE CORNER MIN./SUGGESTED 1 FT. (0.3M)
  - CLEARANCE TO INSIDE CORNER MIN./SUGGESTED 1 FT. (0.3M)
  - CLEARANCE ABOVE PAVED SIDEWALK OR PAVED DRIVEWAY LOCATED ON PUBLIC PROPERTY MIN./SUGGESTED 6-1/2 FT. (2.0M)
  - CLEARANCE ABOVE GRADE, VERANDA, PORCH, DECK, OR BALCONY MIN. 1 FT., SUGGESTED 3-1/2 FT. (0.3M, 1.0M)
  - VERTICAL CLEARANCE BELOW SOFFITS OR FROM ANY ATTIC VENTING COMPONENT MIN./SUGGESTED 3-1/2 FT. (1.0M)
  - HORIZONTAL CLEARANCE FROM AN AREA DIRECTLY BELOW THE DISCHARGE WHERE THERE IS A RISK OF INJURY FROM ICE FALL MIN. 3-1/2 FT., SUGGESTED 6-1/2 FT. (1.0M, 2.0M)
- THE COMPLETION OF A SUBFLOOR DEPRESSURIZATION SYSTEM MAY BE NECESSARY TO REDUCE THE RADON CONCENTRATION TO A LEVEL BELOW THE GUIDELINE SPECIFIED BY HEALTH CANADA.
- FURTHER INFORMATION ON PROTECTION FROM RADON INGRESS CAN BE FOUND IN THE FOLLOWING HEALTH CANADA PUBLICATIONS:
  - RADON: A GUIDE FOR CANADIAN HOMEOWNERS (CMHC/HC), &
  - RADON: REDUCTION GUIDE FOR CANADIANS, &
  - GUIDE FOR RADON MEASUREMENTS IN RESIDENTIAL DWELLINGS (HOMES)

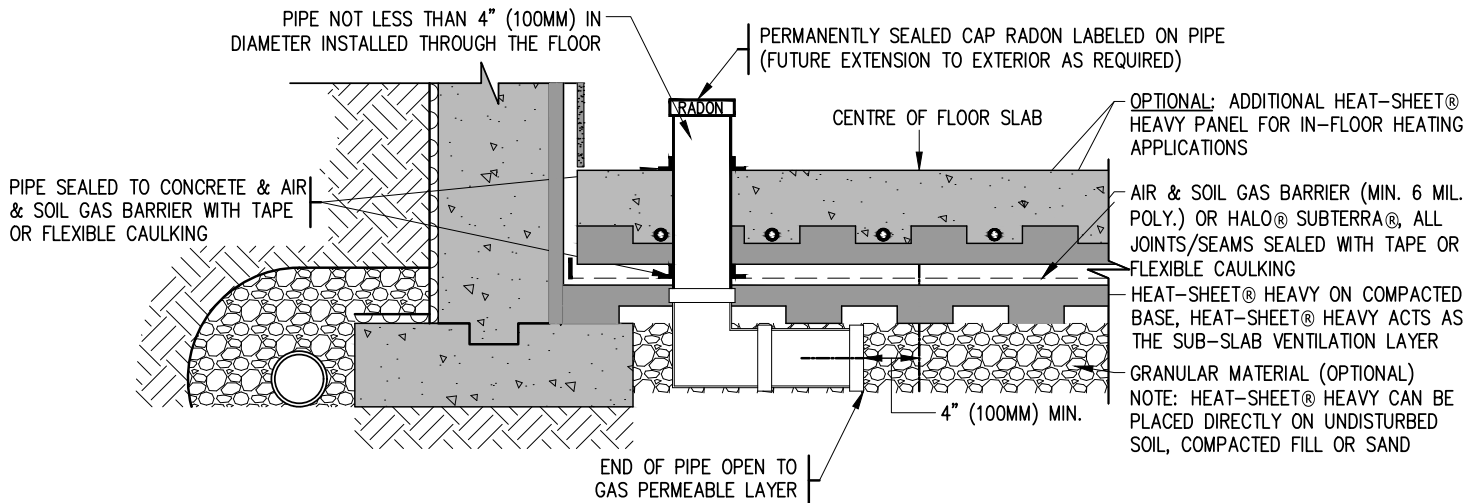


**NOTES:**

- RADON PIPE CAN BE VENTED THROUGH CEILING/ROOF TO THE EXTERIOR OR THROUGH FOUNDATION WALL TO THE EXTERIOR. EXHAUST FAN MUST BE LOCATED NEAR THE OUTLET.
- THE FOLLOWING REQUIREMENTS ARE THE SUGGESTED MINIMUM SETBACKS/CLEARANCES FROM A PASSIVE RADON STACK TERMINATION CLEARANCE FOR ROOF TOP DISCHARGE:
  - VERTICAL CLEARANCE ABOVE THE ROOF AT THE POINT OF PENETRATION 1 FT. (0.3M)
  - VERTICAL CLEARANCE ABOVE WINDOWS OR DOORS 2 FT. 0.6 M
  - VERTICAL CLEARANCE ABOVE MECHANICAL AIR SUPPLY INLET (AIR INTAKE) 3 FT. (0.9M)
  - HORIZONTAL CLEARANCE FROM WINDOWS, DOORS, OR MECHANICAL AIR SUPPLY INLET 10 FT. (3.0M)
  - CLEARANCE HORIZONTALLY FROM A VERTICAL WALL THAT EXTENDS ABOVE THE ROOF PENETRATED 10 FT. (3.0M)
- THE FOLLOWING REQUIREMENTS ARE THE SUGGESTED MINIMUM SETBACKS/CLEARANCES FOR ACTIVE RADON REDUCTION SYSTEMS:
  - CLEARANCE TO A MECHANICAL AIR SUPPLY INLET MIN. 6-1/2 FT., SUGGESTED 10 FT. (2.0M, 3.0M)
  - CLEARANCE TO PERMANENTLY CLOSED WINDOW MIN. 2 FT, SUGGESTED 3-1/2 FT. (0.6M, 1.0M)
  - CLEARANCE TO A OPENABLE WINDOW MIN./SUGGESTED 6-1/2 FT. (2.0M)
  - CLEARANCE FROM A DOOR THAT MAY BE OPENED MIN. 3-1/2 FT., SUGGESTED 6-1/2 FT. (1.0M, 2.0M)
  - CLEARANCE TO OUTSIDE CORNER MIN./SUGGESTED 1 FT. (0.3M)
  - CLEARANCE TO INSIDE CORNER MIN./SUGGESTED 1 FT. (0.3M)
  - CLEARANCE ABOVE PAVED SIDEWALK OR PAVED DRIVEWAY LOCATED ON PUBLIC PROPERTY MIN./SUGGESTED 6-1/2 FT. (2.0M)
  - CLEARANCE ABOVE GRADE, VERANDA, PORCH, DECK, OR BALCONY MIN. 1 FT., SUGGESTED 3-1/2 FT. (0.3M, 1.0M)
  - VERTICAL CLEARANCE BELOW SOFFITS OR FROM ANY ATTIC VENTING COMPONENT MIN./SUGGESTED 3-1/2 FT. (1.0M)
  - HORIZONTAL CLEARANCE FROM AN AREA DIRECTLY BELOW THE DISCHARGE WHERE THERE IS A RISK OF INJURY FROM ICE FALL MIN. 3-1/2 FT., SUGGESTED 6-1/2 FT. (1.0M, 2.0M)
- THE COMPLETION OF A SUBFLOOR DEPRESSURIZATION SYSTEM MAY BE NECESSARY TO REDUCE THE RADON CONCENTRATION TO A LEVEL BELOW THE GUIDELINE SPECIFIED BY HEALTH CANADA.
- FURTHER INFORMATION ON PROTECTION FROM RADON INGRESS CAN BE FOUND IN THE FOLLOWING HEALTH CANADA PUBLICATIONS:
  - RADON: A GUIDE FOR CANADIAN HOMEOWNERS (CMHC/HC), &
  - RADON: REDUCTION GUIDE FOR CANADIANS, &
  - GUIDE FOR RADON MEASUREMENTS IN RESIDENTIAL DWELLINGS (HOMES)

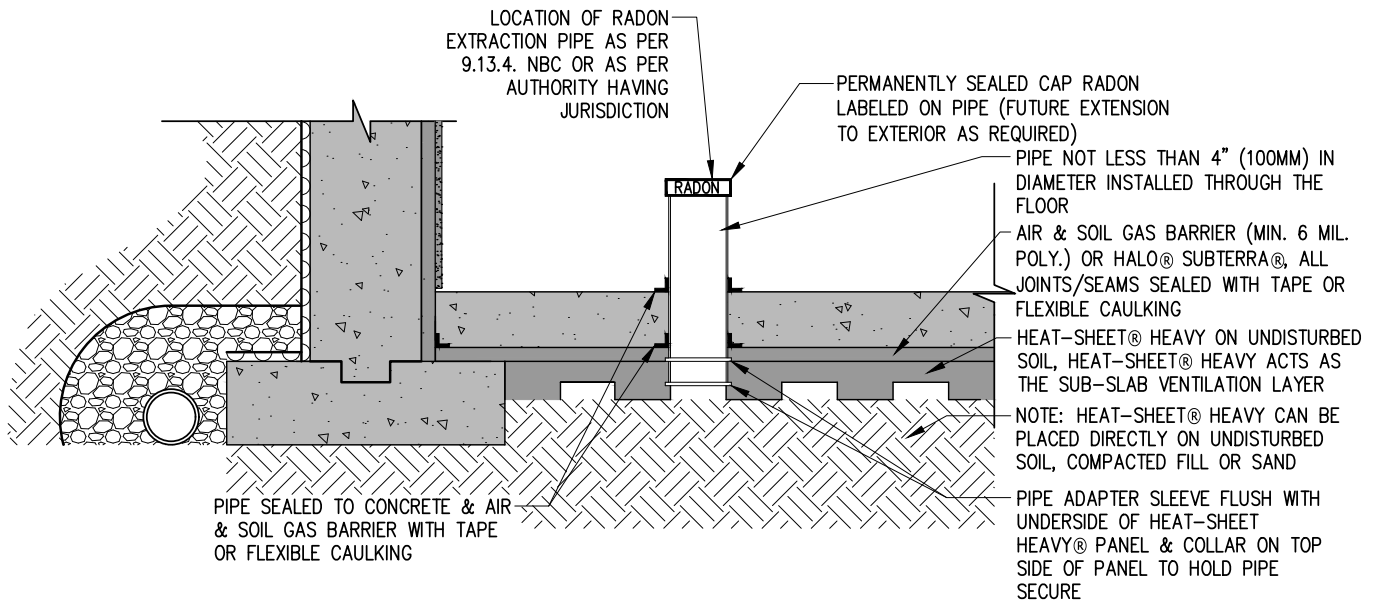


**NOTES:**

- RADON PIPE CAN BE VENTED THROUGH CEILING/ROOF TO THE EXTERIOR OR THROUGH FOUNDATION WALL TO THE EXTERIOR. EXHAUST FAN MUST BE LOCATED NEAR THE OUTLET.
- THE FOLLOWING REQUIREMENTS ARE THE SUGGESTED MINIMUM SETBACKS/CLEARANCES FROM A PASSIVE RADON STACK TERMINATION CLEARANCE FOR ROOF TOP DISCHARGE:
  - VERTICAL CLEARANCE ABOVE THE ROOF AT THE POINT OF PENETRATION 1 FT. (0.3M)
  - VERTICAL CLEARANCE ABOVE WINDOWS OR DOORS 2 FT. 0.6 M
  - VERTICAL CLEARANCE ABOVE MECHANICAL AIR SUPPLY INLET (AIR INTAKE) 3 FT. (0.9M)
  - HORIZONTAL CLEARANCE FROM WINDOWS, DOORS, OR MECHANICAL AIR SUPPLY INLET 10 FT. (3.0M)
  - CLEARANCE HORIZONTALLY FROM A VERTICAL WALL THAT EXTENDS ABOVE THE ROOF PENETRATED 10 FT. (3.0M)
- THE FOLLOWING REQUIREMENTS ARE THE SUGGESTED MINIMUM SETBACKS/CLEARANCES FOR ACTIVE RADON REDUCTION SYSTEMS:
  - CLEARANCE TO A MECHANICAL AIR SUPPLY INLET MIN. 6-1/2 FT., SUGGESTED 10 FT. (2.0M, 3.0M)
  - CLEARANCE TO PERMANENTLY CLOSED WINDOW MIN. 2 FT, SUGGESTED 3-1/2 FT. (0.6M, 1.0M)
  - CLEARANCE TO A OPENABLE WINDOW MIN./SUGGESTED 6-1/2 FT. (2.0M)
  - CLEARANCE FROM A DOOR THAT MAY BE OPENED MIN. 3-1/2 FT., SUGGESTED 6-1/2 FT. (1.0M, 2.0M)
  - CLEARANCE TO OUTSIDE CORNER MIN./SUGGESTED 1 FT. (0.3M)
  - CLEARANCE TO INSIDE CORNER MIN./SUGGESTED 1 FT. (0.3M)
  - CLEARANCE ABOVE PAVED SIDEWALK OR PAVED DRIVEWAY LOCATED ON PUBLIC PROPERTY MIN./SUGGESTED 6-1/2 FT. (2.0M)
  - CLEARANCE ABOVE GRADE, VERANDA, PORCH, DECK, OR BALCONY MIN. 1 FT., SUGGESTED 3-1/2 FT. (0.3M, 1.0M)
  - VERTICAL CLEARANCE BELOW SOFFITS OR FROM ANY ATTIC VENTING COMPONENT MIN./SUGGESTED 3-1/2 FT. (1.0M)
  - HORIZONTAL CLEARANCE FROM AN AREA DIRECTLY BELOW THE DISCHARGE WHERE THERE IS A RISK OF INJURY FROM ICE FALL MIN. 3-1/2 FT., SUGGESTED 6-1/2 FT. (1.0M, 2.0M)
- THE COMPLETION OF A SUBFLOOR DEPRESSURIZATION SYSTEM MAY BE NECESSARY TO REDUCE THE RADON CONCENTRATION TO A LEVEL BELOW THE GUIDELINE SPECIFIED BY HEALTH CANADA.
- FURTHER INFORMATION ON PROTECTION FROM RADON INGRESS CAN BE FOUND IN THE FOLLOWING HEALTH CAANDA PUBLICATIONS:
  - RADON: A GUIDE FOR CANADIAN HOMEOWNERS (CMHC/HC), &
  - RADON: REDUCTION GUIDE FOR CANADIANS, &
  - GUIDE FOR RADON MEASUREMENTS IN RESIDENTIAL DWELLINGS (HOMES)

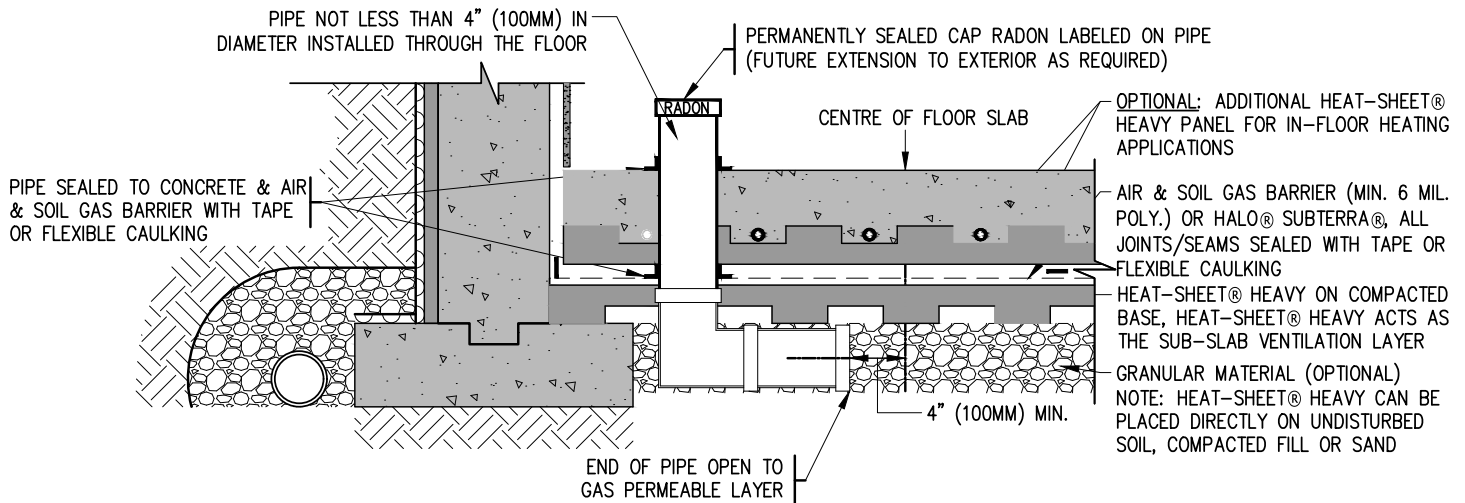

**NOTES:**

- RADON PIPE CAN BE VENTED THROUGH CEILING/ROOF TO THE EXTERIOR OR THROUGH FOUNDATION WALL TO THE EXTERIOR. EXHAUST FAN MUST BE LOCATED NEAR THE OUTLET.
- THE FOLLOWING REQUIREMENTS ARE THE SUGGESTED MINIMUM SETBACKS/CLEARANCES FROM A PASSIVE RADON STACK TERMINATION CLEARANCE FOR ROOF TOP DISCHARGE:
  - VERTICAL CLEARANCE ABOVE THE ROOF AT THE POINT OF PENETRATION 1 FT. (0.3M)
  - VERTICAL CLEARANCE ABOVE WINDOWS OR DOORS 2 FT. 0.6 M
  - VERTICAL CLEARANCE ABOVE MECHANICAL AIR SUPPLY INLET (AIR INTAKE) 3 FT. (0.9M)
  - HORIZONTAL CLEARANCE FROM WINDOWS, DOORS, OR MECHANICAL AIR SUPPLY INLET 10 FT. (3.0M)
  - CLEARANCE HORIZONTALLY FROM A VERTICAL WALL THAT EXTENDS ABOVE THE ROOF PENETRATED 10 FT. (3.0M)
- THE FOLLOWING REQUIREMENTS ARE THE SUGGESTED MINIMUM SETBACKS/CLEARANCES FOR ACTIVE RADON REDUCTION SYSTEMS:
  - CLEARANCE TO A MECHANICAL AIR SUPPLY INLET MIN. 6-1/2 FT., SUGGESTED 10 FT. (2.0M, 3.0M)
  - CLEARANCE TO PERMANENTLY CLOSED WINDOW MIN. 2 FT, SUGGESTED 3-1/2 FT. (0.6M, 1.0M)
  - CLEARANCE TO A OPENABLE WINDOW MIN./SUGGESTED 6-1/2 FT. (2.0M)
  - CLEARANCE FROM A DOOR THAT MAY BE OPENED MIN. 3-1/2 FT., SUGGESTED 6-1/2 FT. (1.0M, 2.0M)
  - CLEARANCE TO OUTSIDE CORNER MIN./SUGGESTED 1 FT. (0.3M)
  - CLEARANCE TO INSIDE CORNER MIN./SUGGESTED 1 FT. (0.3M)
  - CLEARANCE ABOVE PAVED SIDEWALK OR PAVED DRIVEWAY LOCATED ON PUBLIC PROPERTY MIN./SUGGESTED 6-1/2 FT. (2.0M)
  - CLEARANCE ABOVE GRADE, VERANDA, PORCH, DECK, OR BALCONY MIN. 1 FT., SUGGESTED 3-1/2 FT. (0.3M, 1.0M)
  - VERTICAL CLEARANCE BELOW SOFFITS OR FROM ANY ATTIC VENTING COMPONENT MIN./SUGGESTED 3-1/2 FT. (1.0M)
  - HORIZONTAL CLEARANCE FROM AN AREA DIRECTLY BELOW THE DISCHARGE WHERE THERE IS A RISK OF INJURY FROM ICE FALL MIN. 3-1/2 FT., SUGGESTED 6-1/2 FT. (1.0M, 2.0M)
- THE COMPLETION OF A SUBFLOOR DEPRESSURIZATION SYSTEM MAY BE NECESSARY TO REDUCE THE RADON CONCENTRATION TO A LEVEL BELOW THE GUIDELINE SPECIFIED BY HEALTH CANADA.
- FURTHER INFORMATION ON PROTECTION FROM RADON INGRESS CAN BE FOUND IN THE FOLLOWING HEALTH CANADA PUBLICATIONS:
  - RADON: A GUIDE FOR CANADIAN HOMEOWNERS (CMHC/HC), &
  - RADON: REDUCTION GUIDE FOR CANADIANS, &
  - GUIDE FOR RADON MEASUREMENTS IN RESIDENTIAL DWELLINGS (HOMES)

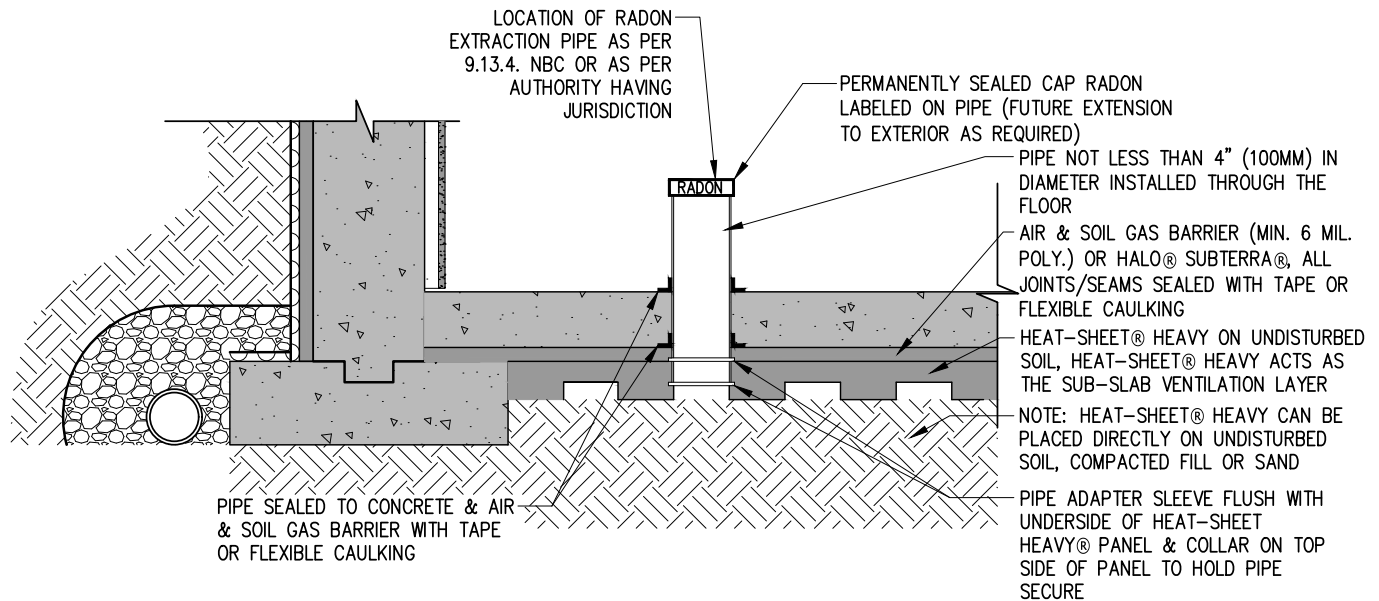

**NOTES:**

- RADON PIPE CAN BE VENTED THROUGH CEILING/ROOF TO THE EXTERIOR OR THROUGH FOUNDATION WALL TO THE EXTERIOR. EXHAUST FAN MUST BE LOCATED NEAR THE OUTLET.
- THE FOLLOWING REQUIREMENTS ARE THE SUGGESTED MINIMUM SETBACKS/CLEARANCES FROM A PASSIVE RADON STACK TERMINATION CLEARANCE FOR ROOF TOP DISCHARGE:
  - VERTICAL CLEARANCE ABOVE THE ROOF AT THE POINT OF PENETRATION 1 FT. (0.3M)
  - VERTICAL CLEARANCE ABOVE WINDOWS OR DOORS 2 FT. 0.6 M
  - VERTICAL CLEARANCE ABOVE MECHANICAL AIR SUPPLY INLET (AIR INTAKE) 3 FT. (0.9M)
  - HORIZONTAL CLEARANCE FROM WINDOWS, DOORS, OR MECHANICAL AIR SUPPLY INLET 10 FT. (3.0M)
  - CLEARANCE HORIZONTALLY FROM A VERTICAL WALL THAT EXTENDS ABOVE THE ROOF PENETRATED 10 FT. (3.0M)
- THE FOLLOWING REQUIREMENTS ARE THE SUGGESTED MINIMUM SETBACKS/CLEARANCES FOR ACTIVE RADON REDUCTION SYSTEMS:
  - CLEARANCE TO A MECHANICAL AIR SUPPLY INLET MIN. 6-1/2 FT., SUGGESTED 10 FT. (2.0M, 3.0M)
  - CLEARANCE TO PERMANENTLY CLOSED WINDOW MIN. 2 FT, SUGGESTED 3-1/2 FT. (0.6M, 1.0M)
  - CLEARANCE TO A OPENABLE WINDOW MIN./SUGGESTED 6-1/2 FT. (2.0M)
  - CLEARANCE FROM A DOOR THAT MAY BE OPENED MIN. 3-1/2 FT., SUGGESTED 6-1/2 FT. (1.0M, 2.0M)
  - CLEARANCE TO OUTSIDE CORNER MIN./SUGGESTED 1 FT. (0.3M)
  - CLEARANCE TO INSIDE CORNER MIN./SUGGESTED 1 FT. (0.3M)
  - CLEARANCE ABOVE PAVED SIDEWALK OR PAVED DRIVEWAY LOCATED ON PUBLIC PROPERTY MIN./SUGGESTED 6-1/2 FT. (2.0M)
  - CLEARANCE ABOVE GRADE, VERANDA, PORCH, DECK, OR BALCONY MIN. 1 FT., SUGGESTED 3-1/2 FT. (0.3M, 1.0M)
  - VERTICAL CLEARANCE BELOW SOFFITS OR FROM ANY ATTIC VENTING COMPONENT MIN./SUGGESTED 3-1/2 FT. (1.0M)
  - HORIZONTAL CLEARANCE FROM AN AREA DIRECTLY BELOW THE DISCHARGE WHERE THERE IS A RISK OF INJURY FROM ICE FALL MIN. 3-1/2 FT., SUGGESTED 6-1/2 FT. (1.0M, 2.0M)
- THE COMPLETION OF A SUBFLOOR DEPRESSURIZATION SYSTEM MAY BE NECESSARY TO REDUCE THE RADON CONCENTRATION TO A LEVEL BELOW THE GUIDELINE SPECIFIED BY HEALTH CANADA.
- FURTHER INFORMATION ON PROTECTION FROM RADON INGRESS CAN BE FOUND IN THE FOLLOWING HEALTH CAANDA PUBLICATIONS:
  - RADON: A GUIDE FOR CANADIAN HOMEOWNERS (CMHC/HC), &
  - RADON: REDUCTION GUIDE FOR CANADIANS, &
  - GUIDE FOR RADON MEASUREMENTS IN RESIDENTIAL DWELLINGS (HOMES)



## Connect with a Local Manufacturer

**888.838.5038**

330 Cain Drive  
Haysville, KS 67060-2004

**888.453.5961**

#215-44393 Simpson Rd.  
Chilliwack, BC V2R 5M3

**888.706.7709**

840 Division St.  
Cobourg, ON K9A 5V2

**800.647.6130**

2604 Sunset Dr.  
Grenada, MS 38901

**877.789.7622**

35 Headingley Rd.  
Headingley, MB R4H 0A8

**800.647.6130**

106 Perma R Rd.  
Johnson City, TN 37604

**888.453.5961**

11581-272 St.  
Acheson, AB T7X 6E9

**800.860.3626**

6753 Chestnut Ridge Rd.  
Beach City, OH 44608

[info@logixbrands.com](mailto:info@logixbrands.com)  
[LogixBrands.com](http://LogixBrands.com)

**LOGIX**<sup>®</sup>  
BRANDS  
ENGINEERED INSULATION PRODUCTS